

Uponor Siccus 16

EN Technical information

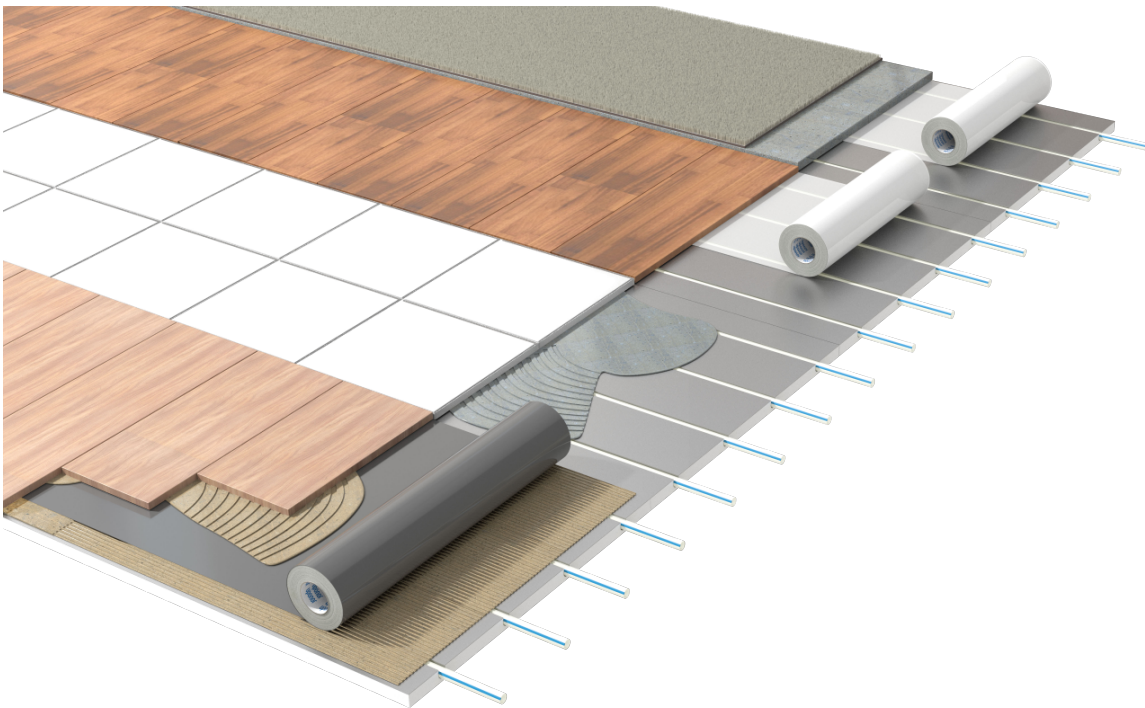


Table of contents

- 1 System description..... 3**
 - 1.1 Benefits..... 3
 - 1.2 Components..... 4
 - 1.3 Copyright and disclaimer..... 5

- 2 Planning/design..... 6**
 - 2.1 Floor constructions..... 6
 - 2.2 Load-bearing subsurface..... 9
 - 2.3 Direct installation method for tiles/natural stone flooring..... 10
 - 2.4 Dimensioning diagrams..... 12
 - 2.5 Pressure drop diagrams..... 22

- 3 Installation..... 24**
 - 3.1 Installation process..... 24

- 4 Technical data..... 25**
 - 4.1 Technical specifications..... 25

1 System description



The Uponor Siccus 16 is a dry underfloor heating and cooling system suitable for modernising residential buildings. The system offers low-height floor construction by providing complete underfloor heating with a minimum number of components and can be used on different subfloors.

Two sophisticated components: The Uponor Siccus 16 is a combination of low height underfloor heating and cooling panel with heat-conducting surface and one of Uponor 16 mm underfloor heating pipes such as Uponor Comfort Pipe PLUS, Uponor Comfort Pipe, Uponor Smart UFH-pipe or Uponor MLCP RED Pipe. This system enables direct flooring without screed for parquet, laminate, tiles and soft floorings such as carpets and vinyl.

Flexible to use and easy to cut: The Siccus 16 installation panel is equipped with built-in pipe guide channels that securely hold the Uponor UFH 16 mm pipes. This panel is highly adaptable and comes pre-fitted with channels in the "head area" to allow for any necessary pipe passage. This process is known as butt-joint installation.

This installation method allows the panels to effortlessly adapt to different floor constructions. If additional channels are needed for creating specific loop shapes, they can be easily cut out using an electric PS cutting tool. Furthermore, the Siccus 16 panel includes three extra channels on one side to facilitate additional loops for feeding pipes.

Lay directly on a level floor: For floating laminate, parquet flooring, or carpet and vinyl over dry screed, lay the installation panel directly on the level subfloor, adding extra insulation if needed. Make sure the subfloor meets the dimensional tolerances specified in EN 18202, Table 3. Then, install the Uponor heating pipes with a spacing of 150 mm.

For ceramic tiles, natural stone or wooden flooring, glue the Siccus 16 panels to the subfloor, following the adhesive provider's technical specifications. Additionally, glue edging support around the perimeter of the rooms and doorways.

1.1 Benefits

- Optimised energy efficiency
- Direct flooring without additional screed option
- No waiting time for final flooring
- No coordination of multiple trades
- Ceramic tiles, natural stone and wooden flooring can be directly installed under specified conditions and technology
- Optimized hydraulic performance of UFH systems, ideal for both renovations and new constructions
- Fast installation on a compatible base floor with no waiting time for the final flooring

1.2 Components



Note

For more detailed information, product range and documentation, please visit the Uponor website: www.uponor.com.



Note

For detailed information about the product range, dimensions and availability, please refer to the Uponor price list.

Uponor Siccus 16 panel




RP0000382

The Uponor Siccus 16 panel is an EPS400 panel grade 400kpa with dimensions 1200 x 600 x 20 mm and can be installed on top of the existing floor. The prefabricated panel is integrated with pipe grooves with a fixed pipe spacing of 150 mm.

The prefabricated aluminium foil of thickness 0,2 mm applied on top of the panel ensures a uniform heat distribution. The panel does not require an additional heat emission plate.

A live load up to 2 kN/m² or a point load up to 2 kN can use this panel.


Uponor Siccus 16 edge support

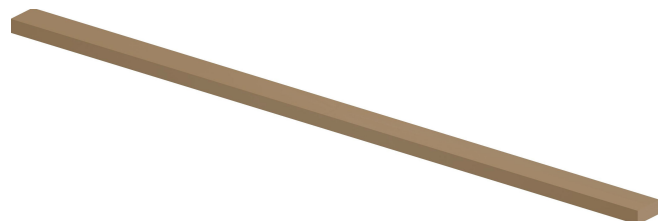

RP0000383

The Uponor Siccus 16 edge support is a MDF strip with dimensions 1000 x 45 x 19 mm and is ideal for installing on the wall sides and in doorways. The edge support is only used for tiles or natural stone installations, not for direct parquet or laminate installations.

Uponor Siccus 16 panel blank

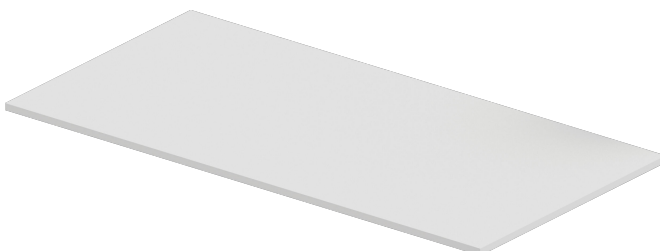

RP0000386

The Uponor Siccus 16 panel blank is a XPS 400 thermal insulation panel with dimensions 1200 x 600 x 20 mm. The panel is ideal for use in front of a manifold, allowing for easier installation of heating pipes.

Uponor Siccus PS Cutter



RP0000384

The Uponor Siccus PS Cutter is a thermal cutting tool for EPS/XPS, designed without a head and compatible with Siccus head in size 16 mm. The cutter operates at 230V and 50/60Hz.

Uponor Comfort Pipe PLUS




RP0000382

The Uponor Comfort Pipe PLUS is a highly flexible PE-Xa pipe with 5 layers available in the dimension 16 x 2,0 mm.

The pipe fulfils the requirements for oxygen diffusion tightness as per DIN 4726.

Uponor Comfort Pipe

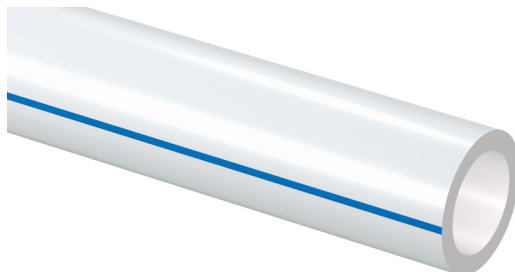

RP0000123

The Uponor Comfort Pipe is a highly flexible PE-Xa pipe available in the dimension 16 x 1,8 mm.

The pipe fulfils the requirements for oxygen diffusion tightness as per DIN 4726.

Uponor Smart UFH-pipe




RP0000347

The Uponor Smart UFH-pipe is a PE-RT pipe and is an economical system for underfloor heating available in the dimension 16 x 2,0 mm.

The pipe fulfils the requirements for oxygen diffusion tightness as per DIN 4726.

Uponor MLCP RED

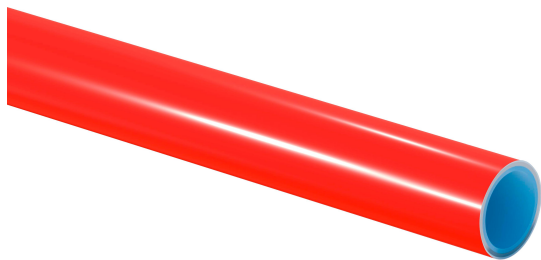

RP0000337

The Uponor MLCP RED is a composite pipe which is stable and easy to install, available in the dimension 16 x 2,0 mm.


The pipe fulfils the requirements for oxygen diffusion tightness as per DIN 4726.

Uponor jointing technology



Note

Only use fittings recommended by Uponor or its representatives.

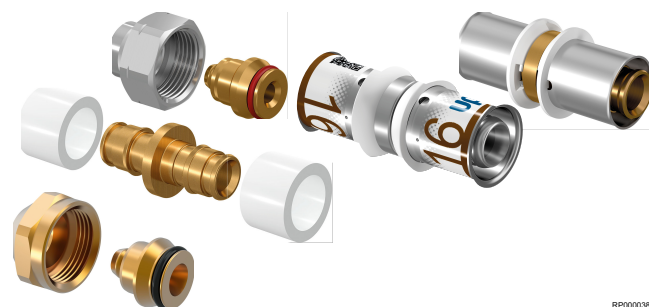

RP0000386

Compression, Press, and Q&E joints are available to connect with respective pipes.

1.3 Copyright and disclaimer

“Uponor” is a registered trademark of Uponor Corporation.

Uponor has prepared this document solely for information purposes, images are only representations of the products. The content (text and images) of the document is protected by worldwide copyright laws and treaty provisions. You agree to comply with these when using the document. Modification or use of any of the content for any other purpose is a violation of Uponor's copyright, trademark, and other proprietary rights.

While Uponor has made all effort to ensure that the document is accurate, the company does not guarantee or warrant the accuracy of the information. Uponor reserves the right to change the product portfolio and the related documentation without prior notification, in line with its policy of continuous improvement and development.

This is a generic, European-wide document version. The document may show products that are not available in your location for technical, legal, commercial, or other reasons. Therefore, check the Uponor product/price list in advance whether the product is deliverable in your location.

Always make sure that the system or product complies with current local standards and regulations. Uponor cannot

guarantee the full compliance of the product portfolio and related documents with all local regulations, standards, or working methods.

Uponor disclaims all warranties related to the content of this document, expressed or implied, to the fullest extent permissible unless otherwise agreed or statutory.

Uponor is under no circumstances liable for any indirect, special, incidental, or consequential damage/loss that results from the use or inability to use the product portfolio and related documents.

For any questions or queries, please visit the local Uponor website or speak to your Uponor representative.


2 Planning/design

2.1 Floor constructions

Depending on the surface type, three installation methods are generally possible (for installing the Siccus 16 system refer to and follow the instructions given in the Uponor installation manual).

1. **Laying parquet/laminate:** It is essential to make sure that a separation layer is installed between the top floor and the installation panel.
2. **Laying tiles/natural stone/wooden floor:** Glue tiles, natural stone or wooden flooring directly to the Siccus 16 panels.
3. **Laying carpet/vinyl or other coverings:** A load-bearing subsurface, for example gypsum board, must be installed.


Parquet/laminate design

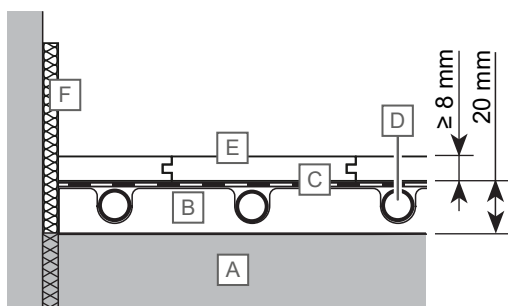

SD0000395

Item	Description
A	Existing floor
B	Uponor Siccus 16 panel
C	Underlayer (for example Arbitron Multiprotection Eco)
D	Uponor UFH Pipe (16 mm)
E	Parquet/laminate
F	Uponor Minitec edging strip


Tiles/natural stone design

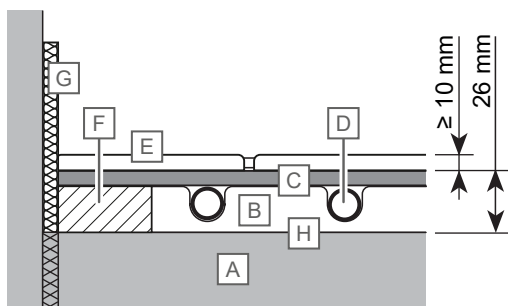

SD0000396

Item	Description
A	Existing floor
B	Uponor Siccus 16 panel
C	Primer + tile adhesive
D	Uponor UFH Pipe (16 mm)
E	Tiles/natural stone
F	Uponor Siccus 16 edge support
G	Uponor Minitec edging strip
H	Panel adhesive


Wet room design

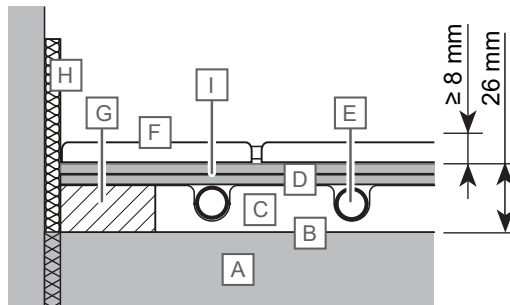

SD0000462

Item	Description
A	Existing floor
B	Panel adhesive
C	Uponor Siccus 16 panel
D	Primer + two-layer adhesive with a waterproof mat (I) in between
E	Uponor UFH Pipe (16 mm)
F	Tiles/natural stone
G	Uponor Siccus 16 edge support
H	Uponor Minitec edging strip
I	Waterproof mat


Wooden design

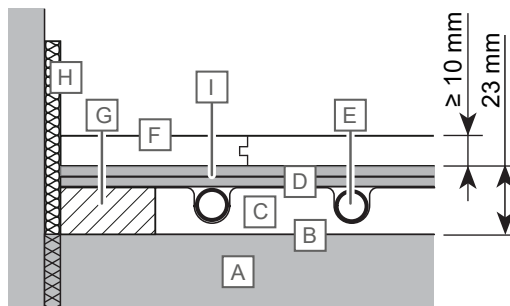

SD0000409

Item	Description
A	Existing floor
B	Panel adhesive
C	Uponor Siccus 16 panel
D	Two-layer adhesive with a coupling mat (I) in between
E	Uponor UFH Pipe (16 mm)
F	Wooden panel (minimum three layers)
G	Uponor Siccus 16 edge support
H	Uponor Minitec edging strip
I	Coupling mat

Carpet/vinyl or other coverings design

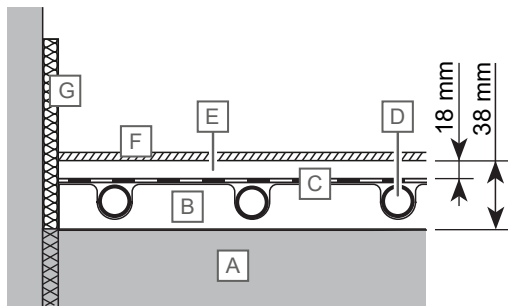






Item	Description
A	Existing floor
B	Uponor Siccus 16 panel
C	Uponor Multi PE foil
D	Uponor UFH Pipe (16 mm)
E	Gypsum board
F	Carpet/vinyl or other coverings
G	Uponor Minitec edging strip

Floor construction tables

As a result of combining insulations, the following constructions comply with the European minimum insulation requirements (refer to EN 1264-4 or EN 15377) for residential and non-residential buildings. Additional planning information for special insulation requirements and different ceiling types, it is necessary to make sure that the construction adheres to DIN 4109 standards.



Direct gluing of the floor covering

	Tiles/natural stone		Tiles/natural stone in wet rooms	Wooden floor	
	Without load distribution layer	With load distribution layer	Without load distribution layer	Without load distribution layer	With load distribution layer
Direct flooring without insulation	- Tiles/natural stone - Adhesive ²⁾ - Uponor Siccus 16 panel - Adhesive ²⁾	-	- Tiles/natural stone - Adhesive ²⁾ - Coupling mat ²⁾ - Adhesive ²⁾ - Uponor Siccus 16 panel - Adhesive ²⁾	- Wooden panel (minimum three layers) - Adhesive ²⁾ - Coupling mat ²⁾ - Adhesive ²⁾ - Uponor Siccus 16 panel - Adhesive ²⁾	-
Thermal insulation	-	- Tiles/natural stone - Load distribution layer ¹⁾ - Uponor Multi foil PE 0,2 mm - Uponor Siccus 16 panel - Insulation EPS-DEO/XPS/PUR	Insulation is possible, but only when combined with the load distribution layer ¹⁾	-	- Wooden panel (minimum three layers) - Load distribution layer ¹⁾ - Uponor Multi foil PE 0,2 mm - Uponor Siccus 16 panel - Insulation EPS-DEO/XPS/PUR
Sound insulation	-	- Tiles/natural stone - Load distribution layer ¹⁾ - Uponor Multi foil PE 0,2 mm - Uponor Siccus 16 panel - Insulation Knauf WF (wood fiber) ¹⁾	Insulation is possible, but only when combined with the load distribution layer ¹⁾	-	- Wooden panel (minimum three layers) - Load distribution layer ¹⁾ - Uponor Multi foil PE 0,2 mm - Uponor Siccus 16 panel - Insulation Knauf WF (wood fiber) ¹⁾
Additional insulation CS (10) (KPa)/height (mm)	-	EPS-DEO: $\geq 100 / \leq 50$ XPS: $\geq 400 / \leq 50$ PUR: $\geq 150 / \leq 50$ Wood fiber: $\geq 150 / \leq 10$	-	-	EPS-DEO: $\geq 100 / \leq 50$ XPS: $\geq 400 / \leq 50$ PUR: $\geq 150 / \leq 50$ Wood fiber: $\geq 150 / \leq 10$
Height of covering	Tiles ≥ 8 mm Natural stone ≥ 10 mm	¹⁾	Tiles ≥ 8 mm Natural stone ≥ 10 mm	Wooden floor ≥ 10 mm	¹⁾
Tiles/natural stone format	Tiles 100 - 600 mm Natural stone 100 - 600 mm	¹⁾	Tiles 100 - 600 mm Natural stone 100 - 600 mm	-	¹⁾

	Tiles/natural stone		Tiles/natural stone in wet rooms	Wooden floor	
	Without load distribution layer	With load distribution layer	Without load distribution layer	Without load distribution layer	With load distribution layer
					
Live load/point load	2,0 kN/m ² or 2,0 kN	2,0 kN/m ² or 1,0 kN ¹⁾	2,0 kN/m ² or 2,0 kN	2,0 kN/m ² or 2,0 kN	2,0 kN/m ² or 1,0 kN ¹⁾
1) Refer to the Knauf Hugo 18 or Mapei Mapetex. 2) For Mapei adhesive system, see Chapter: Direct flooring with tiles.					

- Use a maximum of one additional layer of insulation under Uponor Siccus to prevent "stacking" of insulation tolerances.
- Do not use soft insulation materials, such as mineral fiber.
- Observe the maximum allowable temperature for the heating layer, particularly for load distribution layer such as gypsum.
- For live loads over 2 kN/m² and/or high point loads, contact the load distribution layer manufacturer and obtain their approval.
- Refer to the Knauf technical installation guide for tile size specifications.

Floating floor covering

	Click parquet/laminate	All coverings
	Without load distribution layer	With load distribution layer
		
Direct flooring without insulation	- Click parquet/laminate - Underlayer (e.g. Arbitron Multiprotection Eco) - Uponor Siccus 16 panel	- All coverings - Load distribution layer ¹⁾ - Uponor Multi foil PE 0,2 mm - Uponor Siccus 16 panel
Thermal insulation	- Click parquet/laminate - Underlayer (e.g. Arbitron Multiprotection Eco) - Uponor Siccus 16 panel - Insulation XPS	- All coverings - Load distribution layer ¹⁾ - Uponor Multi foil PE 0,2 mm - Uponor Siccus 16 panel - Insulation EPS-DEO/XPS/PUR
Sound insulation	- Click parquet/laminate - Underlayer (e.g. Arbitron Multiprotection Eco) - Uponor Siccus 16 panel - Insulation Knauf WF (wood fiber) ¹⁾	- All coverings - Load distribution layer ¹⁾ - Uponor Multi foil PE 0,2 mm - Uponor Siccus 16 panel - Insulation Knauf WF (wood fiber) ¹⁾
Additional insulation CS (10) (KPa)/height (mm)	XPS: ≥ 400 / ≤ 50	EPS-DEO: ≥ 100 / ≤ 50 XPS: ≥ 400 / ≤ 50 PUR: ≥ 150 / ≤ 50 Wood fiber: ≥ 150 / ≤ 10
Height of covering	Parquet ≥ 10 mm Laminate ≥ 8 mm	¹⁾
Tiles/natural stone format	-	¹⁾
Live load/point load	2,0 kN/m ² or 2,0 kN	2,0 kN/m ² or 1,0 kN ¹⁾
1) Refer to the Knauf Hugo 18 or Mapei Mapetex. 2) For Mapei adhesive system, see Chapter: Direct flooring with tiles.		

- Use a maximum of one additional layer of insulation under Uponor Siccus to prevent "stacking" of insulation tolerances.
- Do not use soft insulation materials, such as mineral fiber.
- Observe the maximum allowable temperature for the heating layer, particularly for load distribution layer such as gypsum.
- For live loads over 2 kN/m² and/or high point loads, contact the load distribution layer manufacturer and obtain their approval.
- Refer to the Knauf technical installation guide for tile size specifications.

2.2 Load-bearing subsurface

When installing on wooden beam ceilings or existing floor coverings, it's essential to make sure the level subsurface, especially for dry screed panels. If the subsurface is not level, a leveling layer will be necessary. If there are any uncertainties, it is advisable to consult the manufacturer of the dry screed panels. Additionally, consider the requirements for thermal and impact sound insulation during the floor construction process.

Three methods of leveling layers on the subsurface:


If the load-bearing subsurface does not meet the necessary levelness tolerances, a leveling layer is necessary to level the surface. This applies to both wooden and concrete ceilings in both new and existing buildings. For instance, damaged floorboards in older buildings may need repair, depending on their condition.

Before taking any action, make sure that the floorboards are "healthy," securely fastened, and capable of bearing load. Uneven areas can sometimes be addressed by re-screwing the floorboards, and any cracks or knotholes should be repaired.

Only after these conditions are met you can proceed with installing the Siccus 16 panels. Depending on the required leveling height, the following subsurface leveling methods can be used:

Supporting subsurface:

The supporting subsurface provides the foundational base for the Siccus 16 system. The installer is responsible to examine the subsurface's suitability and evenness, and make sure it is free from hollows and weak points. The subsurface must be dry, with any uneven areas, pipes, cables, etc., removed, and all cracks properly filled. The evenness tolerances of the supporting subsurface must obey DIN EN 18202.



SD0000242

Item	Value				
l (m)	0,1	1	4	10	15
t max. (mm)	1	3	9	12	15

For parquet/ laminate flooring, wooden beam construction with a max. deflection of 1/500 is permitted.


Make sure that the wooden beam construction is in proper condition. Consult and involve professional expertise when necessary.

Sealed dry fill with a cover panel



Caution!

Subsurface conditions: cover panel usage and the self-levelling compound must be thoroughly validated by expert examination to make sure the quality, stability, and safety before installing the Siccus 16 system.

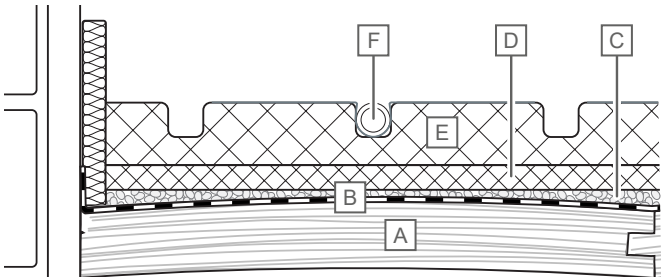

SD0000400

Item	Description
A	Timber joist floor
B	Moisture barrier
C	Self levelling compound
D	Cover panel (according to manufacturer specifications)
E	Uponor Siccus 16 panel
F	Uponor UHF Pipe (16 mm)


Based on the requirements, install a protective layer, for example bitumen paper, over the renovated floorboards and extend it up the walls. If the basement floor has not sufficient insulation or the concrete ceilings are not fully dry, a moisture barrier film must be installed to prevent moisture from rising. The thickness of the leveling layer must be decided in consultation with the manufacturer. Afterward, the floor must be covered with panels for safe walking during the installation of surface heating and the load distribution layer.

Leveling filler



Caution!

Subsurface conditions: the levelling filler specifications must be thoroughly validated by expert examination to make sure the quality, stability, and safety before installing the Siccus 16 system.

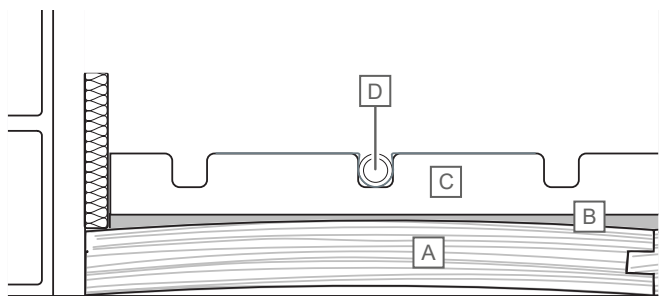

SD0000398


Item	Description
A	Timber joist floor
B	Levelling filler
C	Uponor Siccus 16 panel
D	Uponor UHF Pipe (16 mm)

Uneven concrete ceiling with a leveling screed



Caution!

Subsurface conditions must be thoroughly validated by expert examination to guarantee quality, stability, and safety before installing the Siccus 16 system.

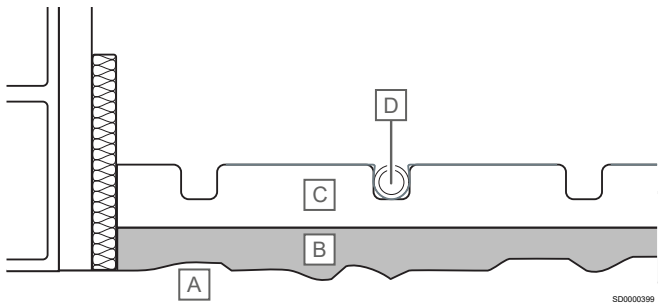

Item	Description
A	Concrete floor
B	Levelling screed
C	Uponor Siccus 16 panel
D	Uponor UFH Pipe (16 mm)

Anhydrite flow screed or synthetic quick-setting screeds are suitable for this application. Obey and follow the manufacturer's guidelines regarding readiness for installation, including remaining moisture levels in the leveling layer and any requirements for primers or bonding agents on the rough ceiling. Additionally, consider the extra weight load on lightweight ceiling structures.

2.3 Direct installation method for tiles/natural stone flooring

The direct floor installation method with tiles, natural stone or wooden floor on Uponor Siccus 16 has been thoroughly tested through type testing in collaboration with Mapei.

The table below present the subsurface constructions and the corresponding Mapei primer and adhesive components:

Dry rooms

Floor construction		Primer	Adhesive Mortar/ several suggestions for standard bonding	Adhesive Mortar/ several suggestions for quick bonding	Additional components
1) Adhesive to install Uponor Siccus 16 panel and Uponor Siccus 16 edge support on subsurface					
Absorptive Subsurface	Cement	Primer G Primer G Pro Eco Prim T Plus	Ultralite S1 Flex ZERO Ultralite S2 Flex Keraflex Maxi S1 ZERO	Ultralite S1 Flex Quick Ultralite S2 Quick Keraflex Quick S1 Keraquick Maxi S1 Ultrabond Eco P16 (for ideal levelled cement floors)	-
	Anydrate	Eco Prim T Plus	Ultralite S1 Flex ZERO Ultralite S2 Flex	Keraflex Quick S1 Keraquick Maxi S1 Ultralite S1 Flex Quick Ultralite S2 Flex Quick	-
Non-absorptive Subsurface	-	Ultracare HD Cleaner	Ultrabond Eco PU 2K Ultrabond Eco S955 1K	-	-
2.1) Direct flooring of ceramic/natural stone on Uponor Siccus 16 panel and Uponor Siccus 16 edge support					
Tiles size: 100 x 100 mm till 600 x 600 mm					
	-	Eco Prim Grip Plus	Ultralite S2 Flex Ultrabond Eco PU 2K	Ultralite S2 Flex Quick	-
For applications with thinner layer requirements	-	-	Kerabond T with Isolastic	-	-
2.2) Joints between tiles					
	-	Minimum joint width of 3 - 4 mm, depending on tile size with MAPEI Ultracolor Plus or Kerapoxy Easy Design. Mapesil LM, Mapesil Tile Matt or Mapesil Stone Matt.			-
3) Direct flooring of wooden floor on Uponor Siccus 16 panel and Uponor Siccus 16 edge support					
2 layers of adhesive must be applied					
1 st layer of adhesive	Primer not recommended	Ultrabond P902 2K Ultrabond P 913 1K Plus Ultrabond Eco P909 2K			-
Coupling mat	-	-	Mapesonic CR applied using a 1 mm toothed trowel with Ultrabond ECO P90 9 2K or any of Mapei's two- component parquet adhesives		
2 nd layer of adhesive	Primer not recommended	Ultrabond P902 2K Ultrabond P 913 1K Plus Ultrabond Eco P909 2K			-

Wet rooms

Floor construction		Primer	Adhesive Mortar/ several suggestions for standard bonding	Adhesive Mortar/ several suggestions for quick bonding	Additional components
1) Adhesive to install Uponor Siccus 16 panel and Uponor Siccus 16 edge support on subsurface					
Absorptive Subsurface	Cement	Primer G Primer G Pro Eco Prim T Plus	Ultralite S1 Flex ZERO Ultralite S2 Flex Keraflex Maxi S1 ZERO	Ultralite S1 Flex Quick Ultralite S2 Quick Keraflex Quick S1 Keraquick Maxi S1 Ultrabond Eco P16 (for ideal levelled cement floors)	-
	Anydrate	Eco Prim T Plus	Ultralite S1 Flex ZERO Ultralite S2 Flex	Keraflex Quick S1 Keraquick Maxi S1 Ultralite S1 Flex Quick Ultralite S2 Flex Quick	-
Non-absorptive Subsurface	-	Ultracare HD Cleaner	Ultrabond Eco PU 2K	Ultrabond Eco P16	-
2.1) Direct flooring of ceramic/natural stone on Uponor Siccus 16 panel and Uponor Siccus 16 edge support					
Tiles size: 100 x 100 mm till 600 x 600 mm					
1 st layer of adhesive	-	Ultrabond Eco PU 2K or Adesilex G19			-
Waterproof membrane					Mapeguard UM 35 or Mapeguard WP 200 Bonding of waterproof membrane: Mapeband W or Mapeband EASY Mapeguard WP For seal expansion joints: Mapesil LM or Mapesil Tile Matt
2 nd layer of adhesive	-	Keraflex Maxi S1 ZERO or Keraflex Quick S1 (happy version)			-
3) Joints between tiles					
Fill the joints minimum 4 mm	-	Ultracolor Plus (color is your choice) or Kerapoxy Easy Design			-

Observe and read Mapei technical documentation.

2.4 Dimensioning diagrams

Bathrooms, showers, toilets and the like are excluded when determining the design flow temperature.

The limit curves must not be exceeded.

$\Delta\vartheta_{H,G}$ is found through the limit curve for the occupied zone with the smallest pipe spacing.

The design supply water temperature maximum must be:

$$\Delta\vartheta_{V,des} = \Delta\vartheta_{H,G} + \Delta\vartheta_l + 2.5 \text{ K.}$$

In cooling mode the supply water temperature depends on the dew point temperature, therefore a humidity sensor has to be installed.

The following diagrams results are accurate and in accordance with EN 1264.

Abbreviations

These abbreviations are used in the following diagrams:


Abbreviations	Unit	Description
$A_{F,max}$	m ²	Maximum surface area of the heating/ cooling area
q_c	W/m ²	Specific thermal output of embedded cooling systems
q_{des}	W/m ²	Design specific thermal output of floor heating systems
$q_{G,max}$	W/m ²	Maximum limit of specific thermal output of floor heating systems
q_H	W/m ²	Specific thermal output of embedded heating systems, excluding floor heating
q_N	W/m ²	Standard thermal output of floor heating systems
$R_{\lambda,B}$	m ² K/W	Thermal resistance of floor covering effective thermal resistance of carpeted covering
$R_{\lambda,ins}$	m ² K/W	Thermal resistance of thermal insulation
s_u	mm	Thickness of the layer above the pipe
T	cm	Pipe spacing
$\vartheta_{F,max}$	°C	Maximum floor surface temperature
ϑ_H	°C	Average temperature of the heating medium
ϑ_i	°C	Standard indoor room temperature
$\Delta\vartheta_i$	K	Temperature difference between designed room temperature and actual room temperature
$\Delta\vartheta_c$	K	Temperature difference between room and cooling medium for cooling systems
$\Delta\vartheta_{c,N}$	K	Standard temperature difference between room and cooling medium for cooling systems
$\Delta\vartheta_H$	K	Temperature difference between heating medium and room
$\Delta\vartheta_{H,G}$	K	Limit temperature difference between heating medium and room for floor heating systems
$\Delta\vartheta_{H,N}$	K	Standard temperature difference between heating medium and room for heating systems, with the exception of floor heating
$\Delta\vartheta_{V,des}$	K	Design temperature difference between flow of heating medium and room of floor heating systems, determined by room with q_{max}
λ_u	W/mK	Thermal conductivity

Uponor Siccus 16 application: Laminate/parquet floating floor as distribution layer ($s_u = 8$ mm with $\lambda_u = 0,17$ W/mK) with embeded Uponor Comfort Pipe PLUS 16 x 2,0 mm



Note

The diagram below shows the tested application.
Laminate is a part of the tested construction.

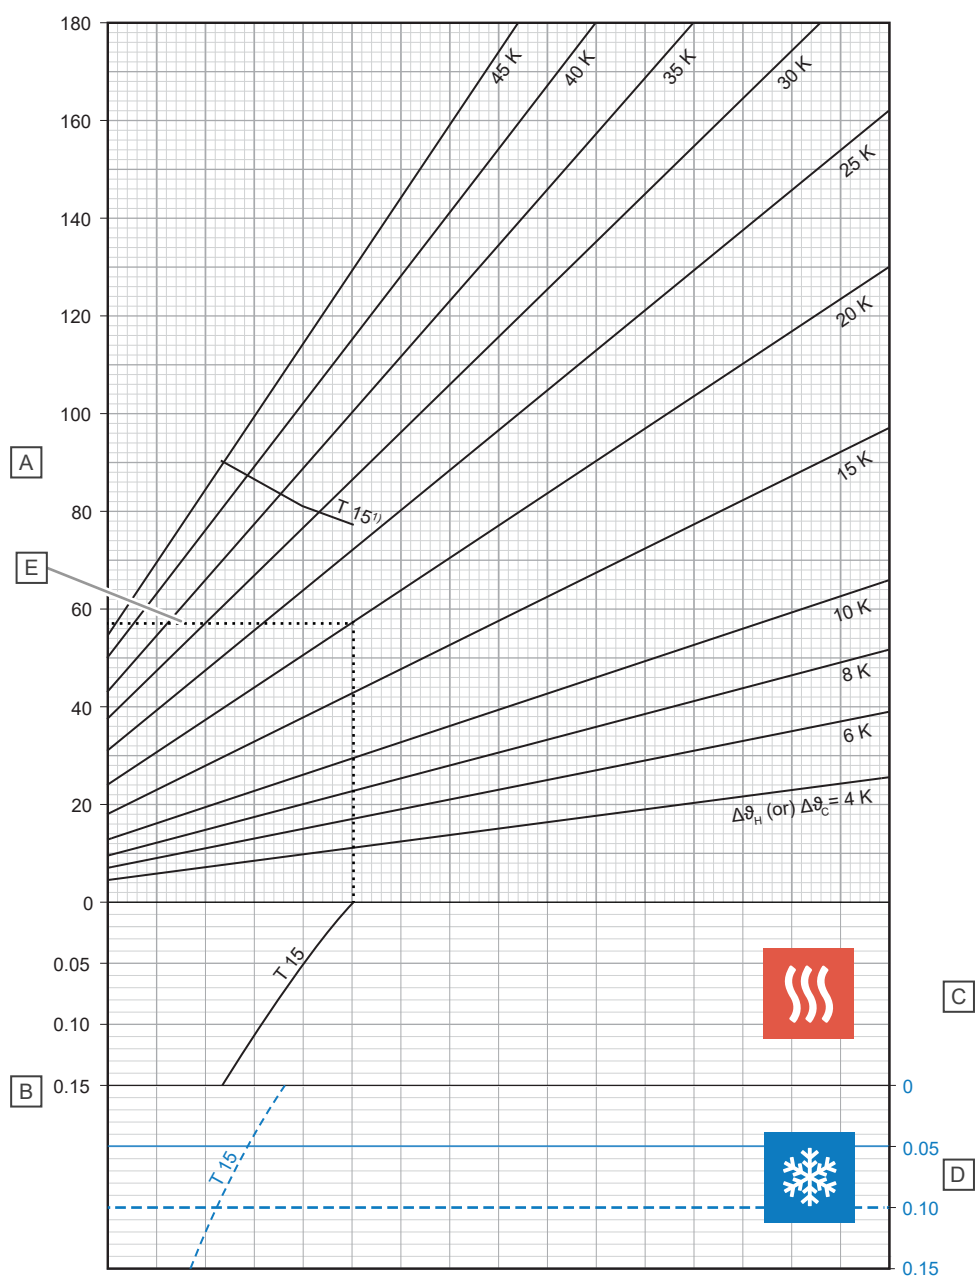

Item	Unit	Description
A	W/m ²	Specific thermal heating or cooling output [q _H or q _C]

B	m ² K/W	Thermal resistance [R _{λ,B}]
---	--------------------	--

C - Heating

T (cm)	q _H (W/m ²)	Δθ _{H,N} (K)
15	77,2	27,46

D - Cooling

T (cm)	q _C (W/m ²)	Δθ _{C,N} (K)
15	19,1	8

E - Example

laminates (3) floating on PE-foil + sound reduction foam (2) on Uponor Siccus 16 panel with embedded Uponor Comfort pipes 16 x 2,0 mm (1).

- q_H = 58 W/m² (by Δθ_H = 20 K)

¹⁾ Limit curve valid for θ_i 20 °C and θ_{F, max} 29 °C or θ_i 24 °C and θ_{F, max} 33 °C

Uponor Siccus 16 application: Laminate/parquet floating floor as distribution layer (su = 8 mm with $\lambda u = 0,17 \text{ W/mK}$) with embeded Uponor MLCP RED 16 x 2,0 mm



Note

The diagram below shows the tested application. Laminate is a part of the tested construction.

The below diagram shows the performance of the laminate/parquet as distribution layer (su = 8 mm with $\lambda u = 0,17 \text{ W/mK}$). If the laminate/parquet is to be replaced with a thicker material, then the following manual conversion must be performed:

Actual:

Laminate $\lambda u = 0,17 \text{ W/mK}$, $d = 0,008 \text{ m}$

$R = d/\lambda u$


$R = 0,008 \text{ m} / 0,17 \text{ W/mK} = 0,047 \text{ m}^2\text{K/W}$

Target (example):

Oak parquet, $R = 0,113 \text{ m}^2\text{K/W}$

Conversion:

$0,113 - 0,047 = 0,066 \text{ m}^2\text{K/W}$

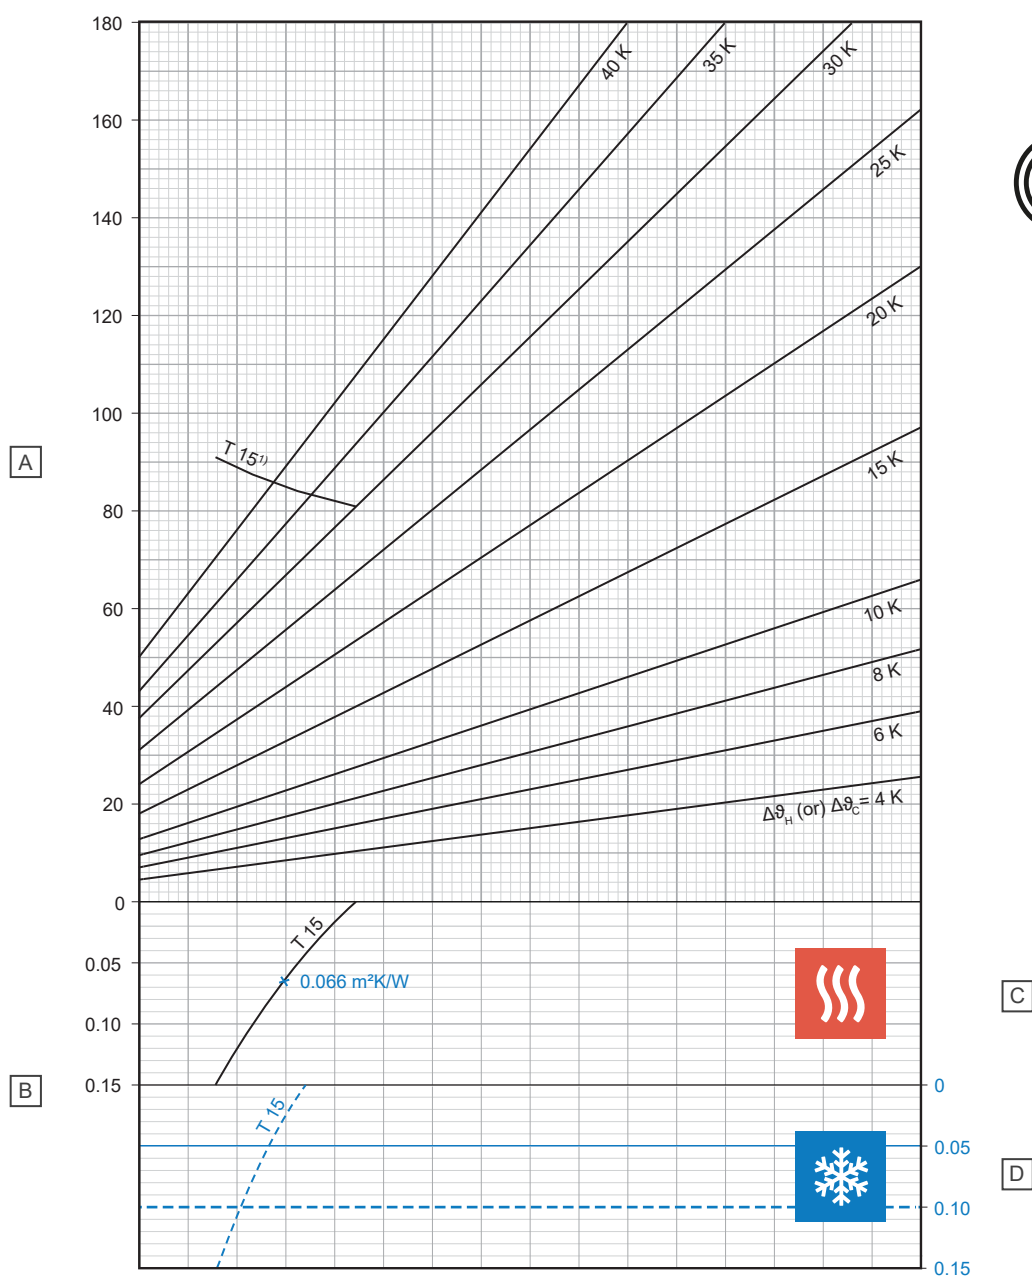

Item	Unit	Description
A	W/m ²	Specific thermal heating or cooling output [q_H or q_C]
B	m ² K/W	Thermal resistance [$R_{\lambda,B}$]

C - Heating

T (cm)	q_H (W/m ²)	$\Delta\vartheta_{H,N}$ (K)
15	80,9	29,99

D - Cooling

T (cm)	q_C (W/m ²)	$\Delta\vartheta_{C,N}$ (K)
15	18,5	8


¹⁾ Limit curve valid for ϑ_i 20 °C and $\vartheta_{F,max}$ 29 °C or ϑ_i 24 °C and $\vartheta_{F,max}$ 33 °C

Uponor Siccus 16 application: Tile/natural stone direct flooring (su = 12 mm) with embedded Uponor Comfort Pipe PLUS 16 x 2,0 mm



Note

The diagram below shows the tested application. The floor coverings are part of the tested construction.

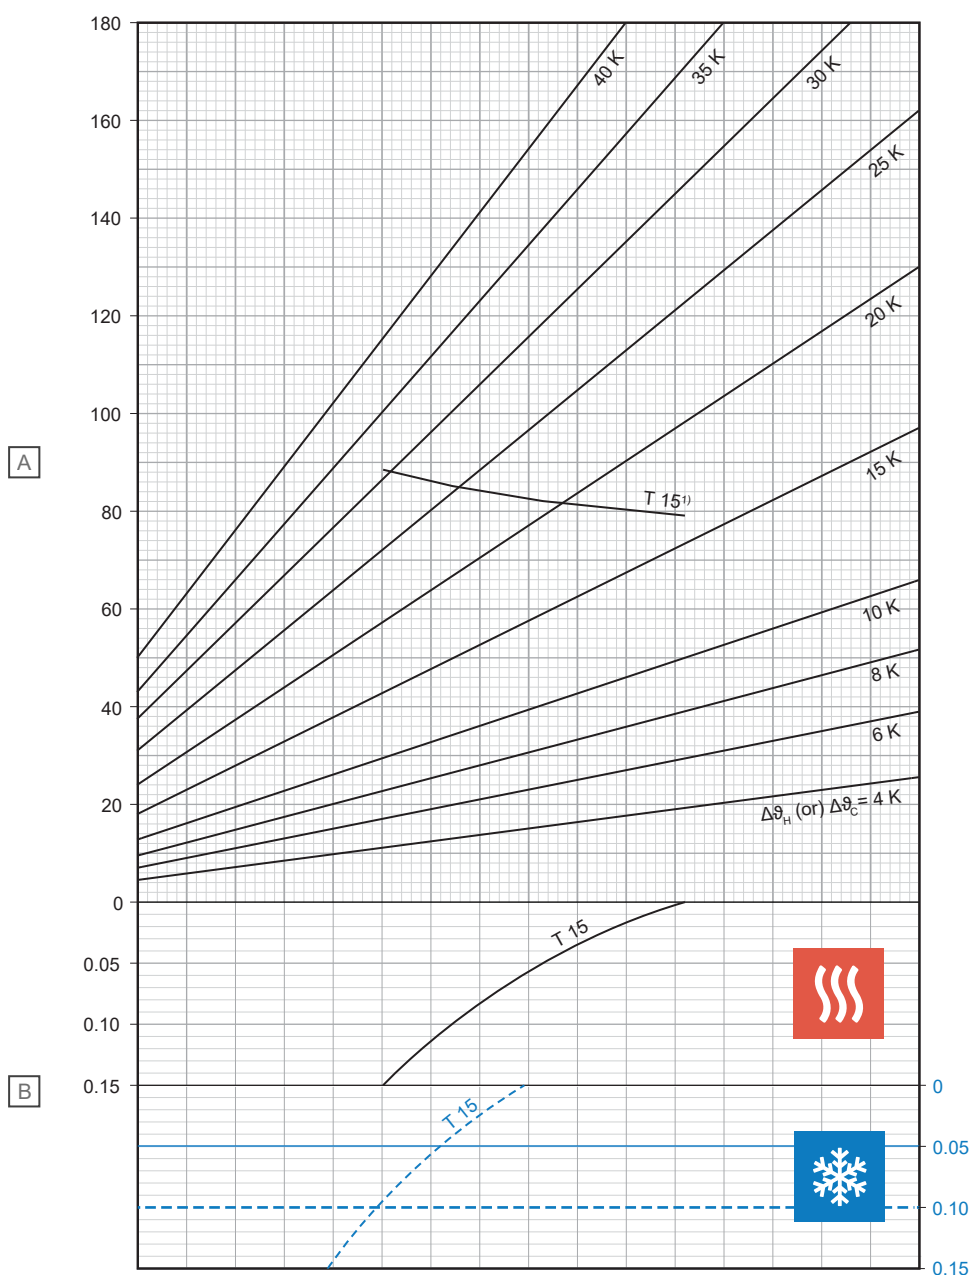

Item	Unit	Description
A	W/m ²	Specific thermal heating or cooling output [q_H or q_C]

Item	Unit	Description
B	m ² K/W	Thermal resistance [$R_{\lambda,B}$]

C - Heating

T (cm)	q _H (W/m²)	Δθ _{H,N} (K)
15	79,1	16,27

D - Cooling

T (cm)	q _C (W/m²)	Δθ _{C,N} (K)
15	30,4	8


1) Limit curve valid for θ_i 20 °C and θ_{F, max} 29 °C or θ_i 24 °C and θ_{F, max} 33 °C

Uponor Siccus 16 application: Tile/natural stone direct flooring (su = 12 mm) with embedded Uponor MLCP RED 16 x 2,0 mm



Note

The diagram below shows the tested application. The floor coverings are part of the tested construction.

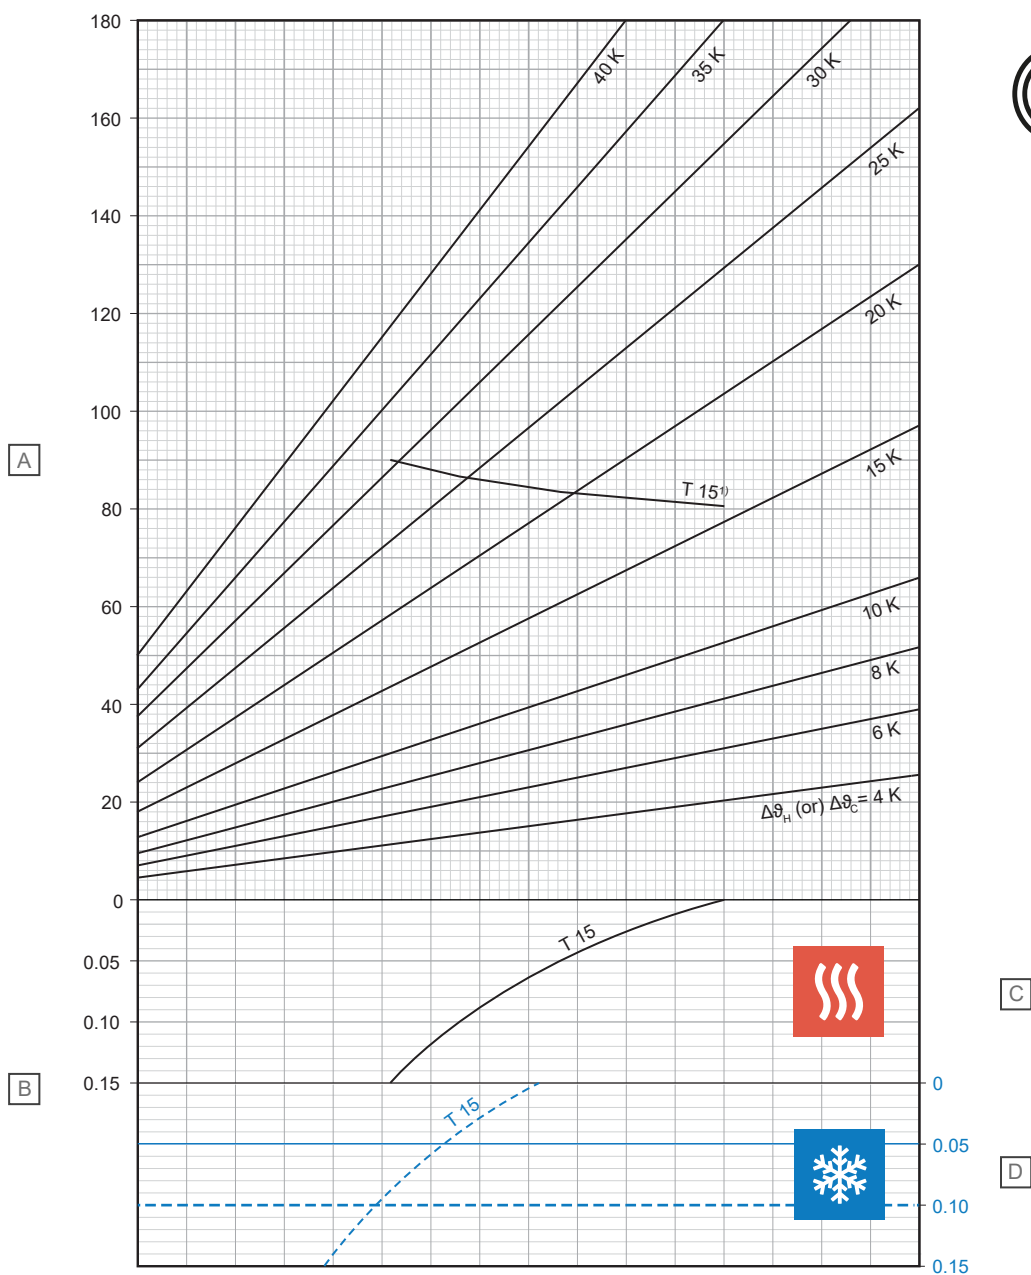

Item	Unit	Description
A	W/m²	Specific thermal heating or cooling output [q _H or q _C]

Item	Unit	Description
B	m²K/W	Thermal resistance [R _{A,B}]

C - Heating

T (cm)	q _H (W/m²)	Δθ _{H,N} (K)
15	80,6	15,70

D - Cooling

T (cm)	q _C (W/m²)	Δθ _{C,N} (K)
15	31,2	8


1) Limit curve valid for θ_i 20 °C and θ_{F, max} 29 °C or θ_i 24 °C and θ_{F, max} 33 °C

Uponor Siccus 16 application: Wooden panel direct flooring (su = 14 mm) with embedded Uponor Comfort Pipe PLUS 16 x 2,0 mm



Note

The diagram below shows the tested application. The floor coverings are part of the tested construction.

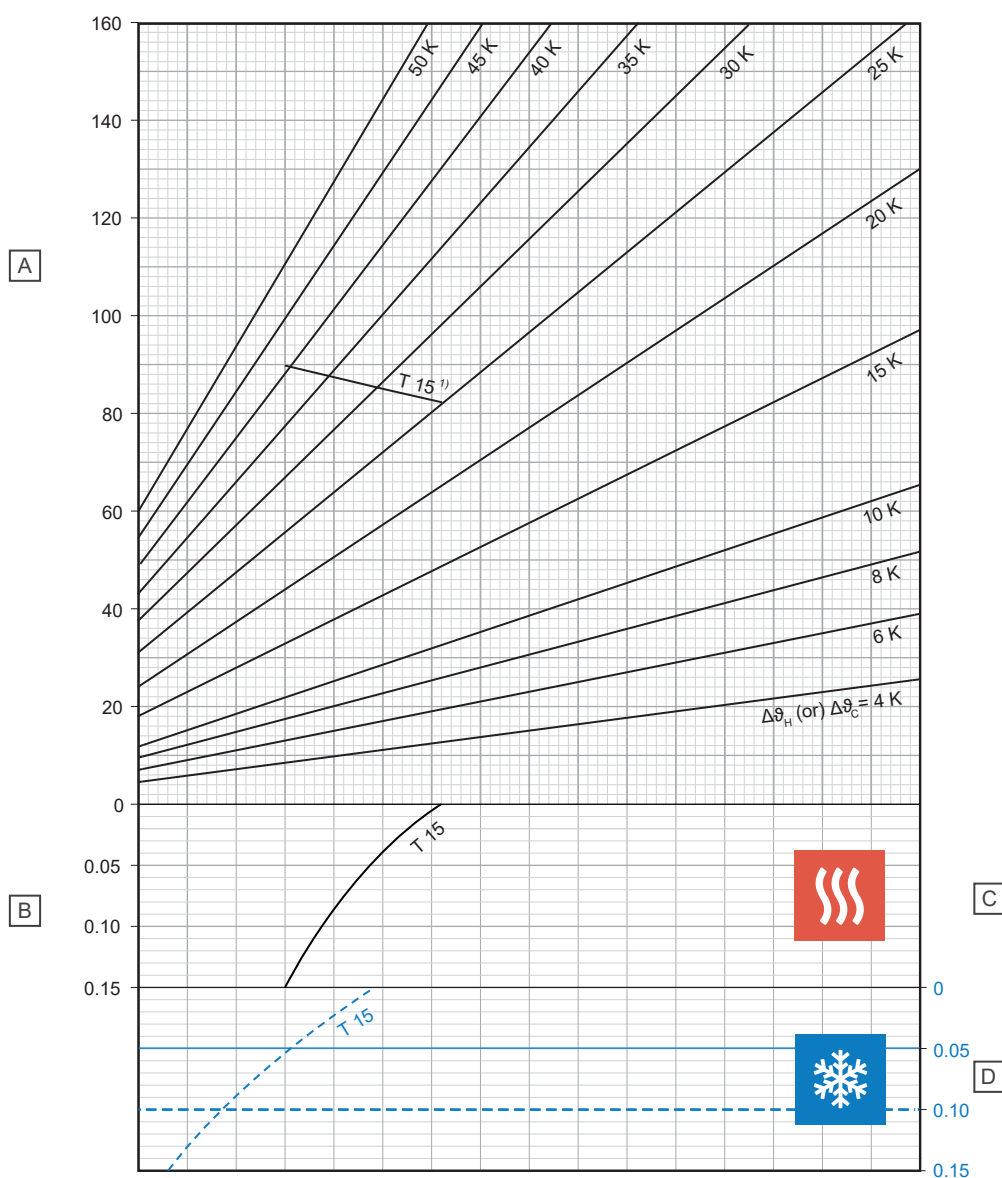

Item	Unit	Description
A	W/m²	Specific thermal heating or cooling output [q _H or q _C]
B	m²K/W	Thermal resistance [R _{A,B}]

C - Heating

T (cm)	q _H (W/m²)	Δθ _{H,N} (K)
15	84,4	24,8

D - Cooling

T (cm)	q _C (W/m²)	Δθ _{C,N} (K)
15	22,5	8


¹⁾ Limit curve valid for ϑ_i 20 °C and $\vartheta_{F, \max}$ 29 °C or ϑ_i 24 °C and $\vartheta_{F, \max}$ 33 °C

Uponor Siccus 16 application: Wooden panel direct flooring (su = 14 mm) with embedded Uponor MLCP RED 16 x 2,0 mm



Note

The diagram below shows the tested application. The floor coverings are part of the tested construction.

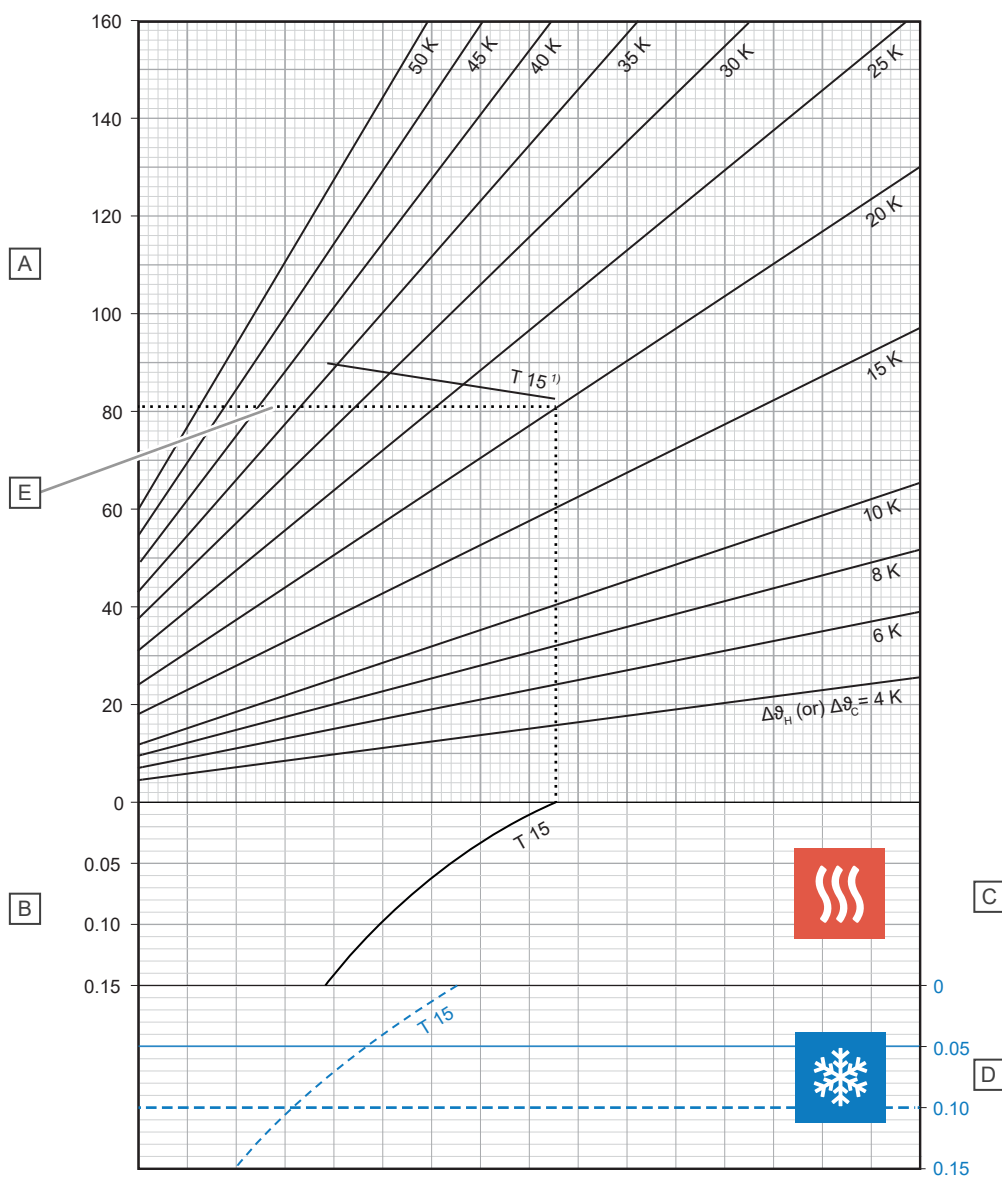

Item	Unit	Description
A	W/m ²	Specific thermal heating or cooling output [q _H or q _C]
B	m ² K/W	Thermal resistance [R _{λ,B}]

C - Heating		
T (cm)	q _H (W/m ²)	Δθ _{H,N} (K)
15	83,1	20,6

D - Cooling		
T (cm)	q _C (W/m ²)	Δθ _{C,N} (K)
15	26,0	8

E - The following case is approved by the notified body

Wooden panels (3) direct glued (2): two-layers of glue with a coupling mat in between, on Uponor Siccus 16 panel with embedded Uponor MLCP RED 16 x 2,0 mm (1).

- q_H = 81 W/m² (by Δθ_H = 20 K)



¹⁾ Limit curve valid for ϑ_i 20 °C and $\vartheta_{F, \max}$ 29 °C or ϑ_i 24 °C and $\vartheta_{F, \max}$ 33 °C

Uponor Siccus 16 application: any covering with gypsum board (su = 18 mm with $\lambda_u = 0,38 \text{ W/mK}$) with embedded Uponor Comfort Pipe PLUS 16 x 2,0 mm



Note

The coverings are not part of the notified body test.

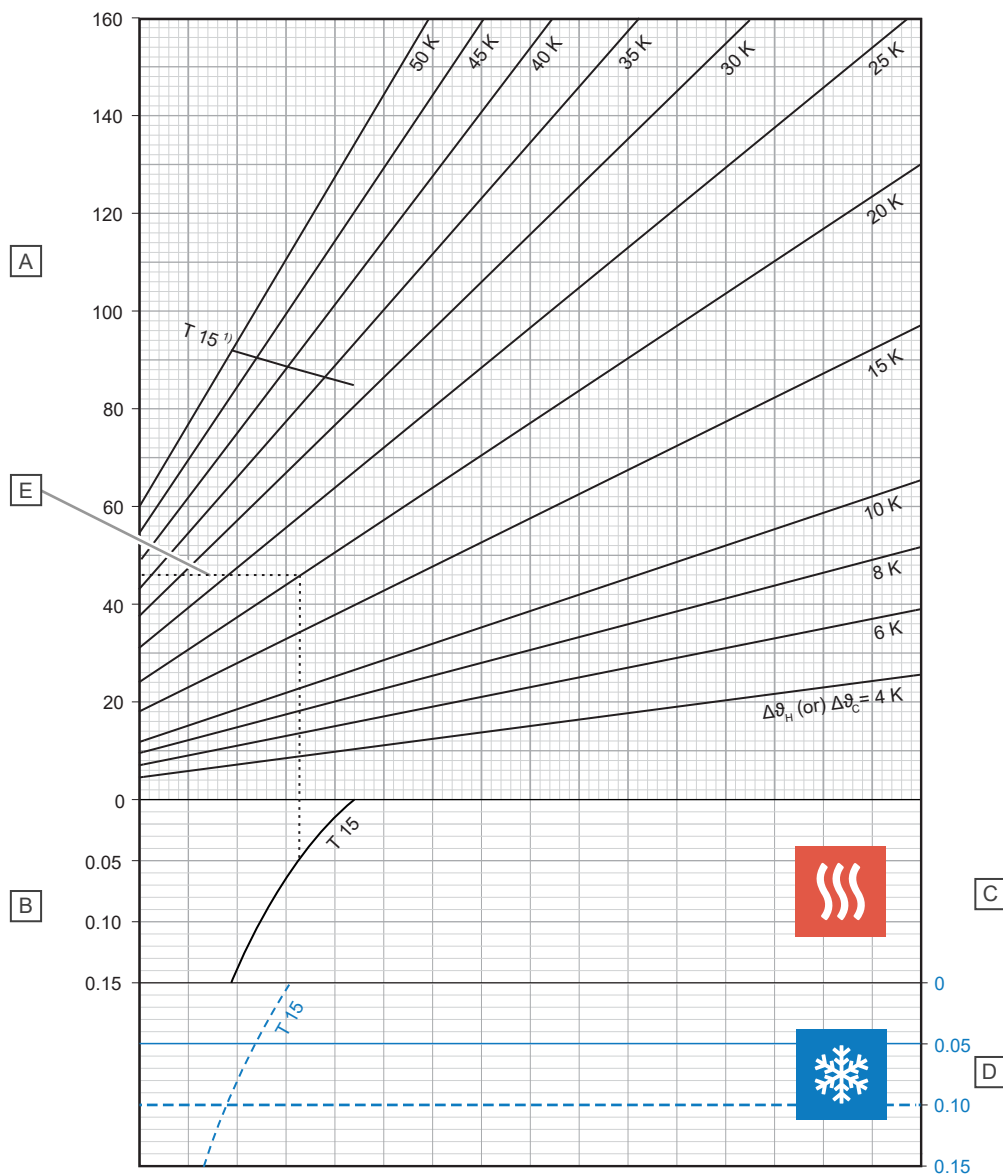

D10000360

Item	Unit	Description
A	W/m ²	Specific thermal heating or cooling output [q_H or q_C]
B	m ² K/W	Thermal resistance [$R_{\lambda,B}$]
C - Heating		
T (cm)	q_H (W/m ²)	$\Delta\vartheta_{H,N}$ (K)
15	84,9	32,0
D - Cooling		
T (cm)	q_C (W/m ²)	$\Delta\vartheta_{C,N}$ (K)
15	18,0	8

E - The example shows additional covering with tiles

Tiles (5) glued (4) on gypsum Knauf Hugo (3) on PE-foil (2) on Uponor Siccus 16 panel with embedded Uponor Comfort pipe PLUS 16 x 2,0 mm (1).

- $q_H = 46 \text{ W/m}^2$ (by $\Delta\vartheta_H = 20 \text{ K}$)


¹⁾ Limit curve valid for $\vartheta_i 20 \text{ }^\circ\text{C}$ and $\vartheta_{F, \max} 29 \text{ }^\circ\text{C}$ or $\vartheta_i 24 \text{ }^\circ\text{C}$ and $\vartheta_{F, \max} 33 \text{ }^\circ\text{C}$

Uponor Siccus 16 application: any covering with gypsum board (su = 18 mm with $\lambda u = 0,38 \text{ W/mK}$) with embedded Uponor MLCP RED 16 x 2,0 mm



Note

The coverings are not part of the notified body test.

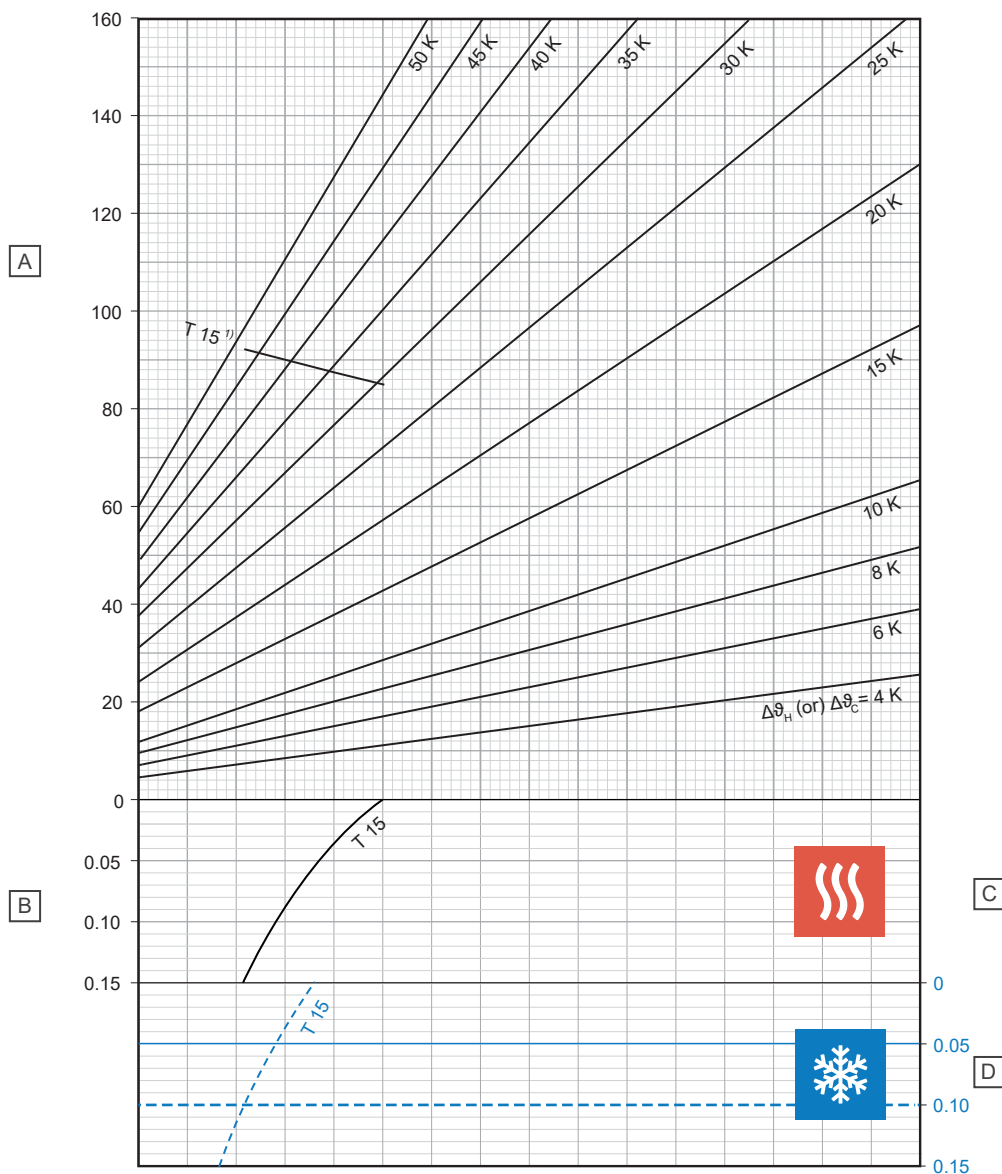

Item	Unit	Description
A	W/m²	Specific thermal heating or cooling output [q_H or q_C]
B	m²K/W	Thermal resistance [$R_{\lambda,B}$]

C - Heating

T (cm)	q_H (W/m²)	$\Delta\theta_{H,N}$ (K)
15	84,6	29,5


D - Cooling

T (cm)	q_C (W/m²)	$\Delta\theta_{C,N}$ (K)
15	19,3	8

¹⁾ Limit curve valid for ϑ_i 20 °C and $\vartheta_{F,max}$ 29 °C or ϑ_i 24 °C and $\vartheta_{F,max}$ 33 °C

2.5 Pressure drop diagrams


Uponor Comfort Pipe PLUS

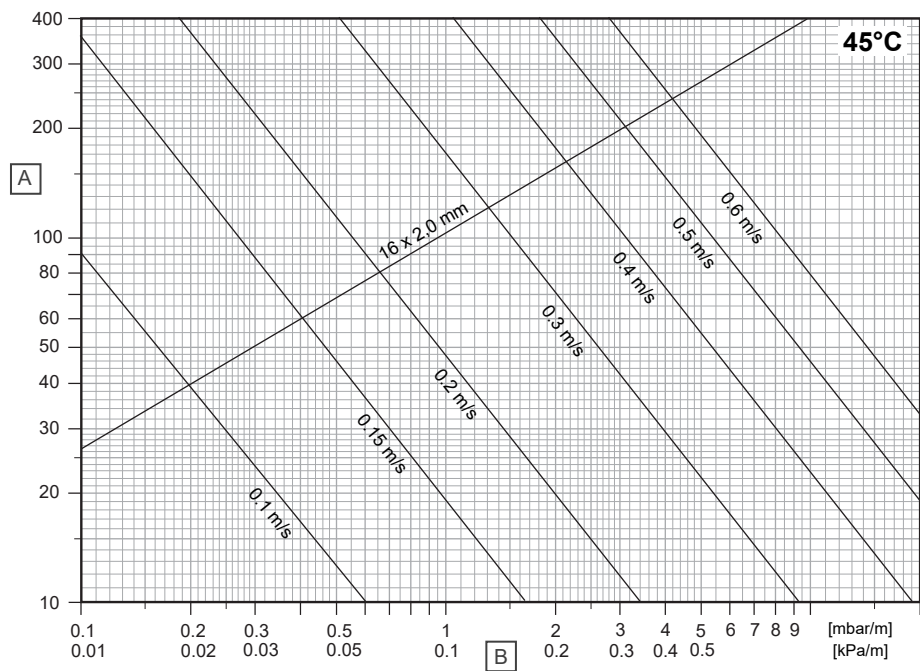

D10000350

Item	Unit	Description
A	kg/h	Mass flow rate
B	R	Pressure gradient


Uponor Comfort Pipe

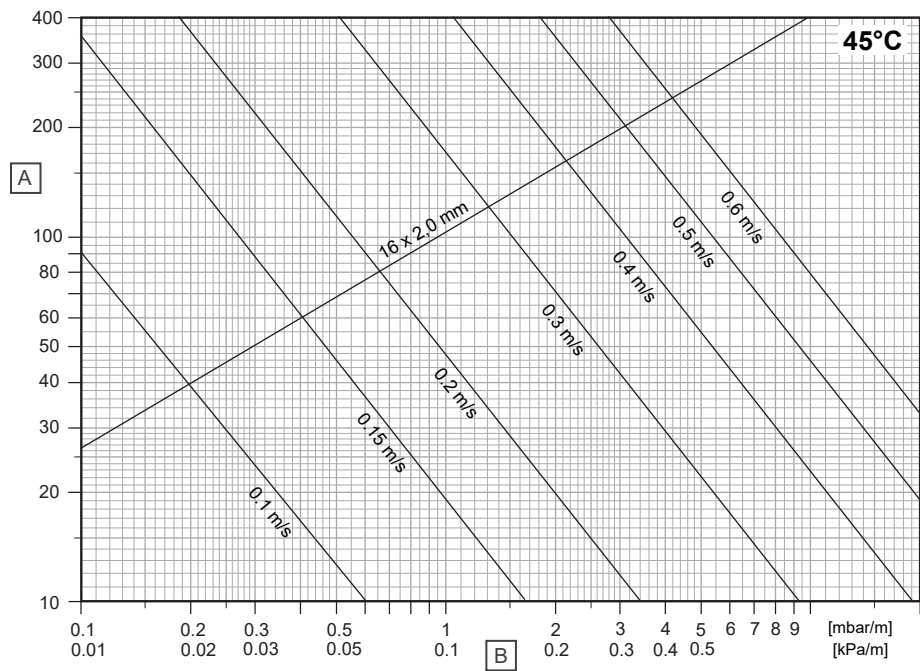

D10000282

Item	Unit	Description
A	kg/h	Mass flow rate
B	R	Pressure gradient


Uponor Smart UFH-pipe

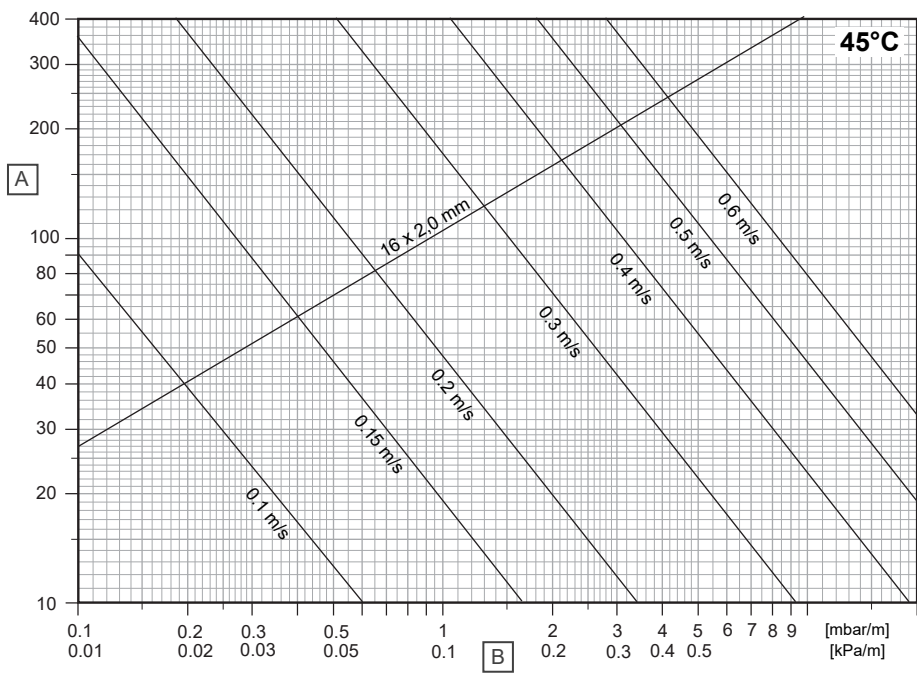

D10000351

Item	Unit	Description
A	kg/h	Mass flow rate
B	R	Pressure gradient

Uponor MLCP RED

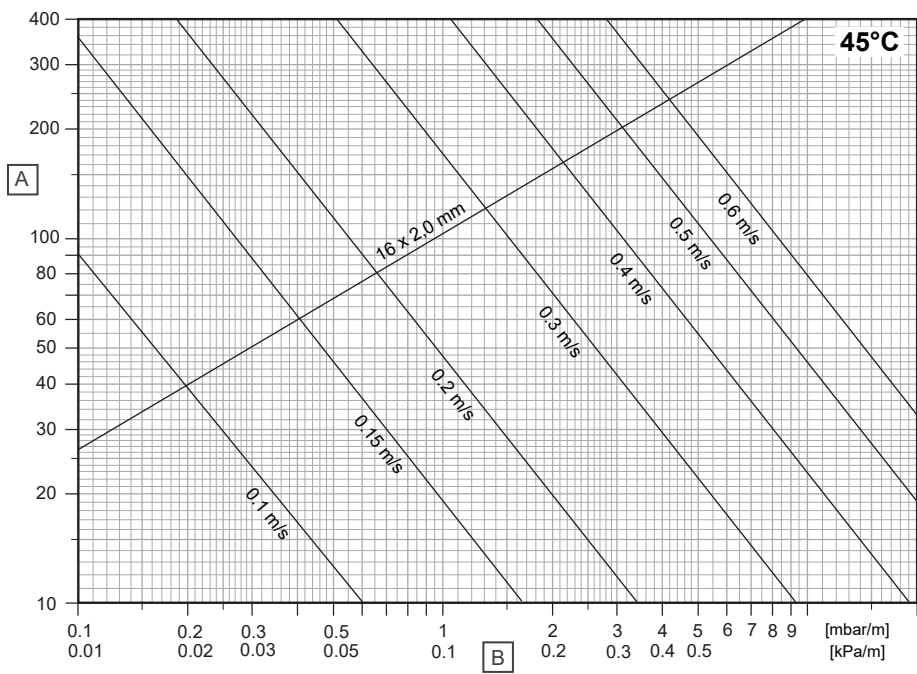

D10000352

Item	Unit	Description
A	kg/h	Mass flow rate
B	R	Pressure gradient

3 Installation

3.1 Installation process



Note

The installation must be performed by a qualified person in accordance with local standards and regulations.




Note

Tiles/ natural stone type coverings require additional installation steps compared to parquet/laminate type coverings. Refer to and follow the instructions given in the installation manual.


As a guidance, always read and follow the instructions given in respective Uponor Siccus 16 installation manual.

1. Multi-edging strip installation

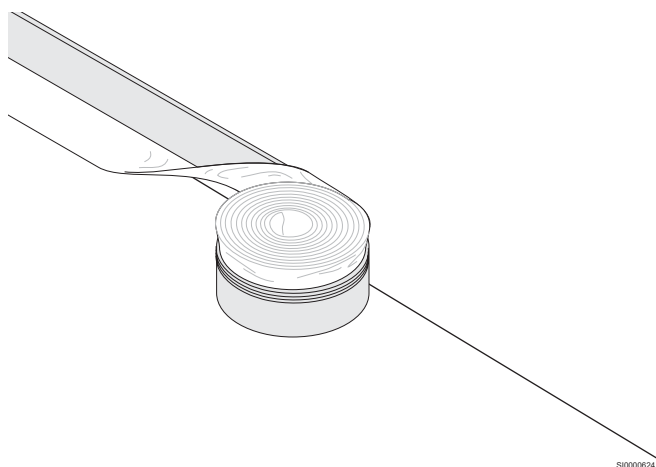


SI0000824

2. Panels installation

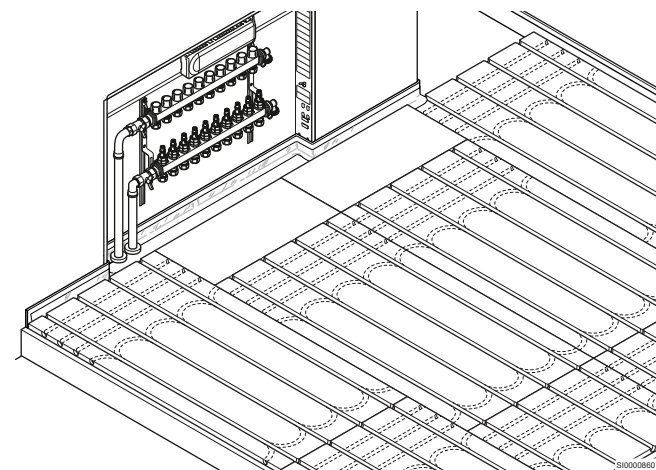


SI0000880

3. Engrave the grooves

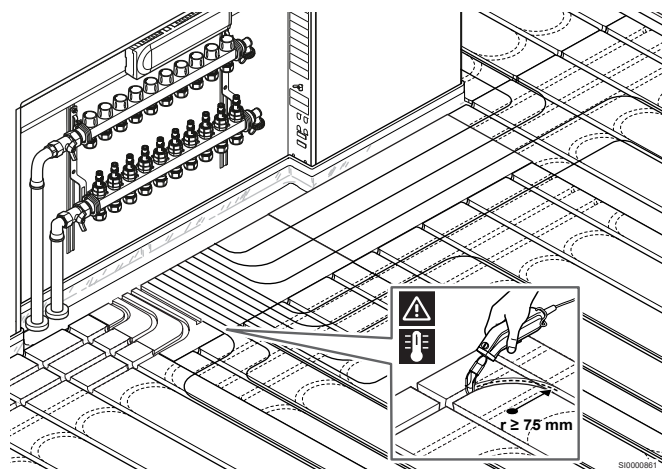


SI0000861

4. Pipes installation

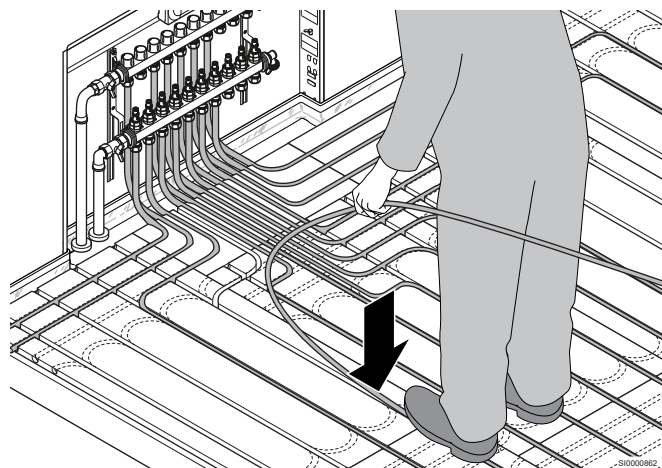

SI0000862

5. Flooring varieties

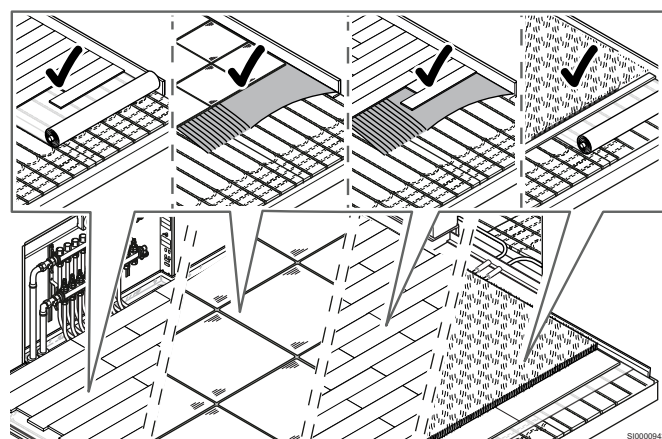

SI0000843

4 Technical data

4.1 Technical specifications

Uponor Siccus 16

Description	Value	Value
Product name	Uponor Siccus 16 panel	Uponor Siccus 16 edge support
Material	EPS 400 kpa	High density synthetic fiber
Dimension	1200 x 600 x 20 mm	1000 x 45 x 19 mm
Max. live load	7,5 KN/m ²	7,5 KN/m ²
Thermal conductivity	0,035 W/mK	-
Thermal resistance	0,57 m ² K/W	-
Reaction to fire (refer to EN 13501-1)	Class E	Class E
Pipe spacing	150 mm	-
Type of system	Dry system	Dry system
Load distribution layer	See floor construction type 2.1	See floor construction type 2.1

Uponor Comfort Pipe PLUS

	Value
Pipe designation	Uponor Comfort Pipe PLUS 16 x 2,0 mm
Pipe dimension	16 x 2,0 mm
Pipe length	120; 240; 640 m
Material	PE-Xa, five-layer pipe
Colour	White with two blue longitudinal stripes
Manufacturing	Refer to EN ISO 15875
Certificates	KOMO, DIN CERTCO
Area of application	Class 4 + 5 / 6 bar (EN ISO 15875)
Max. operating temperature ¹⁾	90 °C (EN ISO 15875)
Max. operating pressure	6 bar at 70° C
Pipe jointings	Uponor screw connection, Uponor Smart press coupling, Uponor Q&E technology
Weight	0,091 kg/m
Water content	0,11 l/m
Oxygen tightness	Refer to ISO 17455; DIN 4726
Density	0,934 g/cm ³
Material class	Class B2 and class E, DIN 4102 / EN 13501
Min. bending radius	8 x D; free-hand bending (128 mm) 5 x D; supported bending (80 mm)
Pipe roughness	0,007 mm
Ideal installation temperature	≥ 0 °C
UV protection	Opaque cardboard (store remaining quantities in the cardboard box)

1) When more than one design temperature appears for any class, the times should be aggregated (e.g. the design temperature profile

for 50 years class 5 is: 20 °C for 14 years followed by 60 °C for 25 years, 80 °C for 10 years, 90 °C for 1 year and 100 °C for 100h).

Uponor Comfort Pipe

	Value
Pipe designation	Uponor Comfort Pipe 16 x 1,8 mm
Pipe dimension	16 x 1,8 mm
Pipe length	240; 640 m
Material	PE-Xa
Colour	White with one blue longitudinal stripe
Manufacturing	Refer to EN ISO 15875
Certificates	DIN CERTCO
Area of application	Class 4 / 6 bar (EN ISO 15875)
Max. operating temperature ¹⁾	90 °C (EN ISO 15875)
Max. operating pressure	6 bar at 70° C
Pipe jointings	Uponor screw connection, Uponor Smart press coupling, Uponor Q&E technology
Weight	0,091 kg/m
Water content	0,11 l/m
Oxygen tightness	Refer to ISO 17455; DIN 4726
Density	0,934 g/cm³
Material class	Class B2 and class E, DIN 4102 / EN 13501
Min. bending radius	8 x D; free-hand bending (128 mm) 5 x D; supported bending (80 mm)
Pipe roughness	0,007 mm
Ideal installation temperature	≥ 0 °C
UV protection	Opaque cardboard (store remaining quantities in the cardboard box)

1) When more than one design temperature appears for any class, the times should be aggregated (e.g. the design temperature profile

for 50 years class 5 is: 20 °C for 14 years followed by 60 °C for 25 years, 80 °C for 10 years, 90 °C for 1 year and 100 °C for 100h).

Uponor Smart UFH-pipe

	Value
Pipe designation	Uponor Smart UFH-pipe 16 x 2,0 mm
Pipe dimension	16 x 2,0 mm
Pipe length	240; 640 m
Material	PE-RT Type II, five-layer pipe
Colour	Natural colour
Manufacturing	Refer to EN ISO 22391
Certificates	KOMO, DIN CERTCO
Area of application	Class 4 + 5 / 6 bar (EN ISO 22391)
Max. operating temperature ¹⁾	90 °C (EN ISO 22391)
Max. operating pressure	6 bar at 70° C
Pipe jointings	Uponor screw connection Uponor Smart press coupling
Weight	0,0846 kg/m
Water content	0,113 l/m
Oxygen tightness	Refer to ISO 17455; DIN 4726
Density	0,941 g/cm³
Material class	Class B2 and class E, DIN 4102 / EN 13501
Min. bending radius	8 x D; free-hand bending (128 mm) 5 x D; supported bending (80 mm)
Pipe roughness	0,007 mm
Ideal installation temperature	≥ 0 °C
UV protection	Opaque cardboard (store remaining quantities in the cardboard box)

1) When more than one design temperature appears for any class, the times should be aggregated (e.g. the design temperature profile

for 50 years class 5 is: 20 °C for 14 years followed by 60 °C for 25 years, 80 °C for 10 years, 90 °C for 1 year and 100 °C for 100h).

Uponor MLCP RED

Description	Value
Pipe designation	Uponor MLCP RED 16 x 2,0 mm
Pipe dimension	16 x 2,0 mm
Pipe length	240; 480 m
Material	Multi-layer composite pipe (PE-RT - aluminium - PE-RT), monitored by SKZ (Southern German Plastics Centre), oxygen-tight refer to DIN 4726.
Colour	Red
Manufacturing	Refer to EN ISO 21003
Certificates	KOMO, DIN CERTCO
Area of application	Class 4 / 5 (ISO 10508)
Max. operating temperature	60 °C
Max. operating pressure	4 bar
Pipe jointings	Uponor screw connection Uponor S-Press PLUS
Weight	0,117 kg/m
Water volume	0,113 l/m
Oxygen tightness	Refer to ISO 17455; DIN 4726
Building material class	Class B2, refer to DIN 4102
Min. bending radius	4xd if free bending (64 mm) 3xd if supported bend (48 mm)
Pipe roughness	0,004 mm
Best mounting temperature	≥ 0 °C
UV protection	Brown cardboard (store remaining quantities in the cardboard box)

Uponor GmbH

Industriestraße 56,
D-97437 Hassfurt, Germany

1145906 v3_07_2026
GF / SKA

Uponor reserves the right to make changes, without prior notification,
to the specification of incorporated components in line with its policy of
continuous improvement and development.



www.uponor.com