


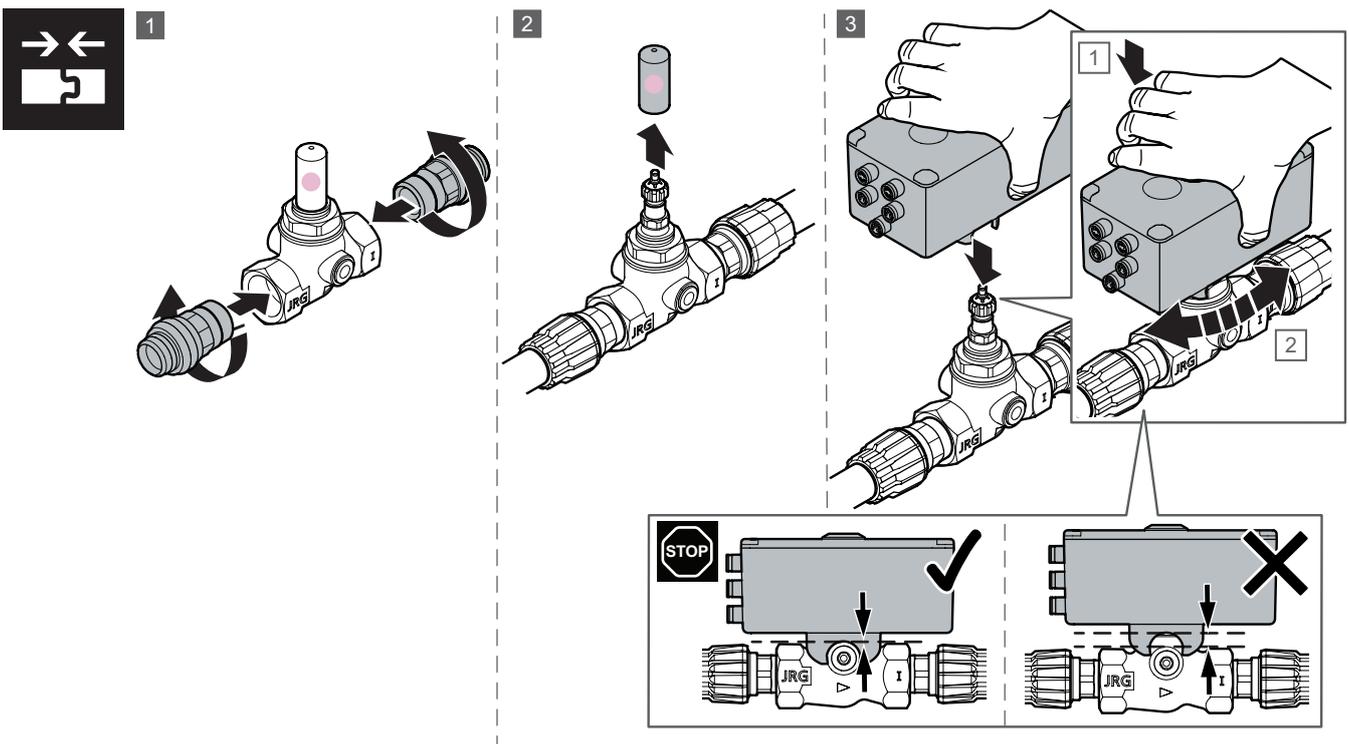


GF Hyclean Balance


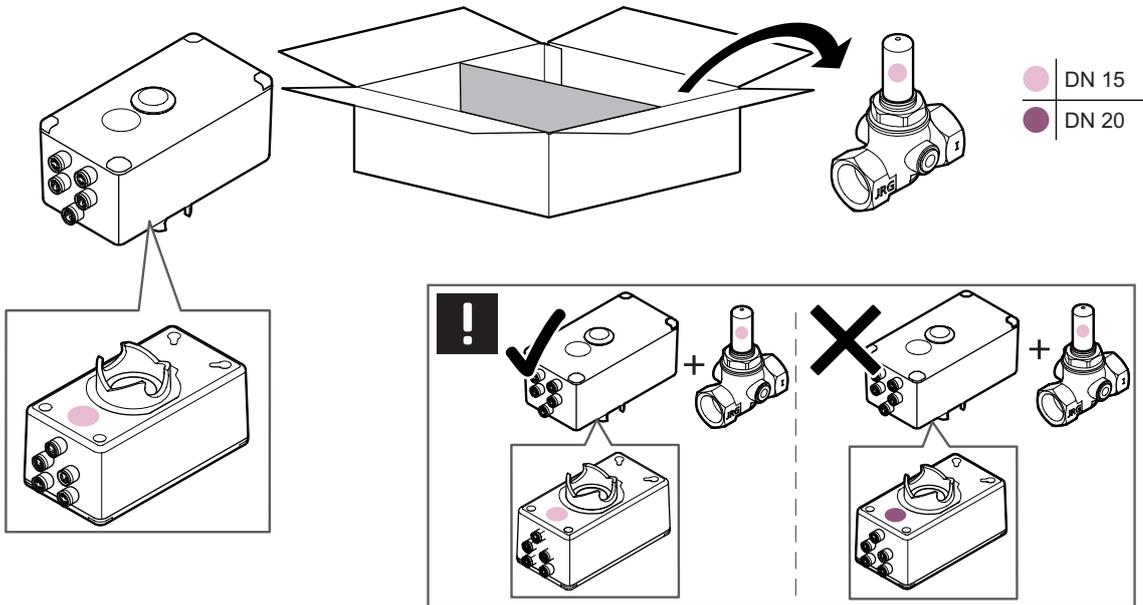


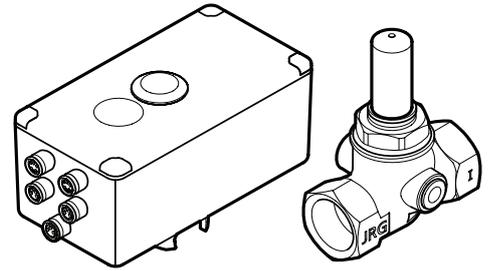


4

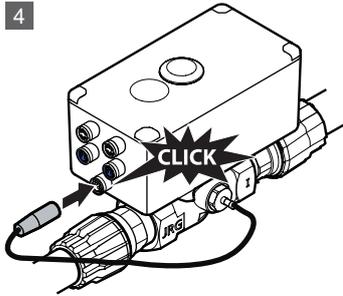


5

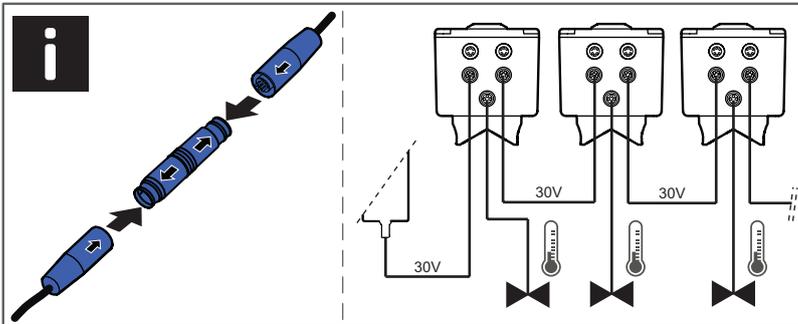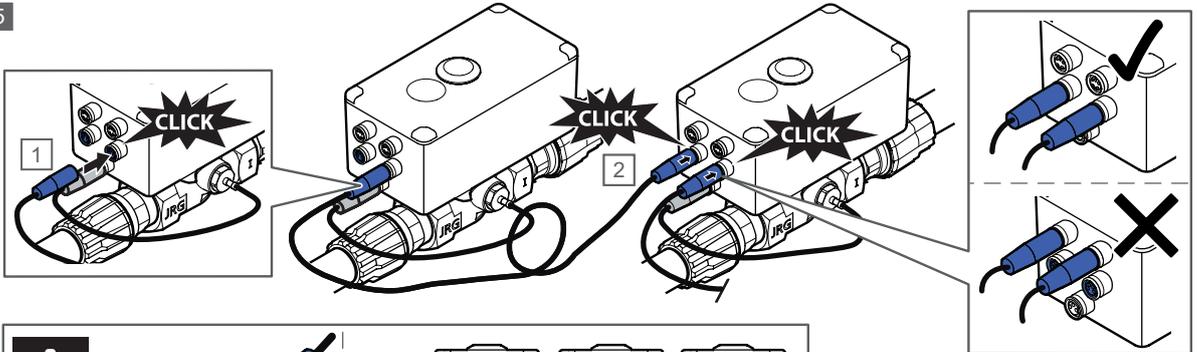


max. 10x
max. 100 m

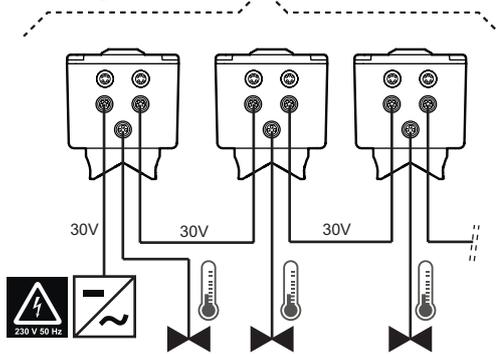



1

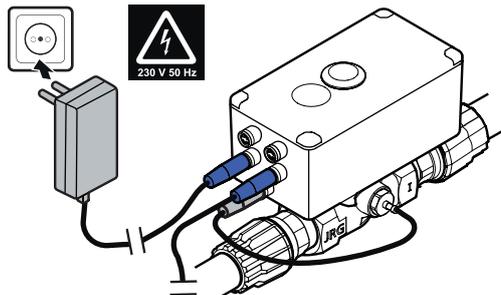


2

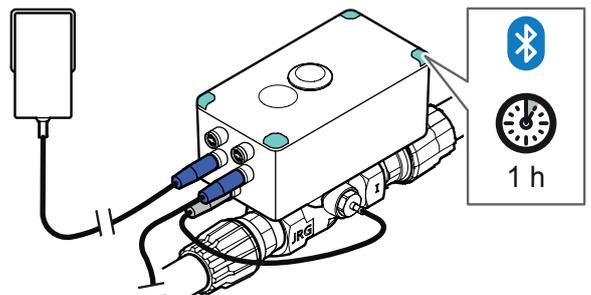

3			reboot	reset	offline
	< 5 s	> 5 s < 10 s	> 10 s < 15 s	> 15 s < 20 s	> 20 s

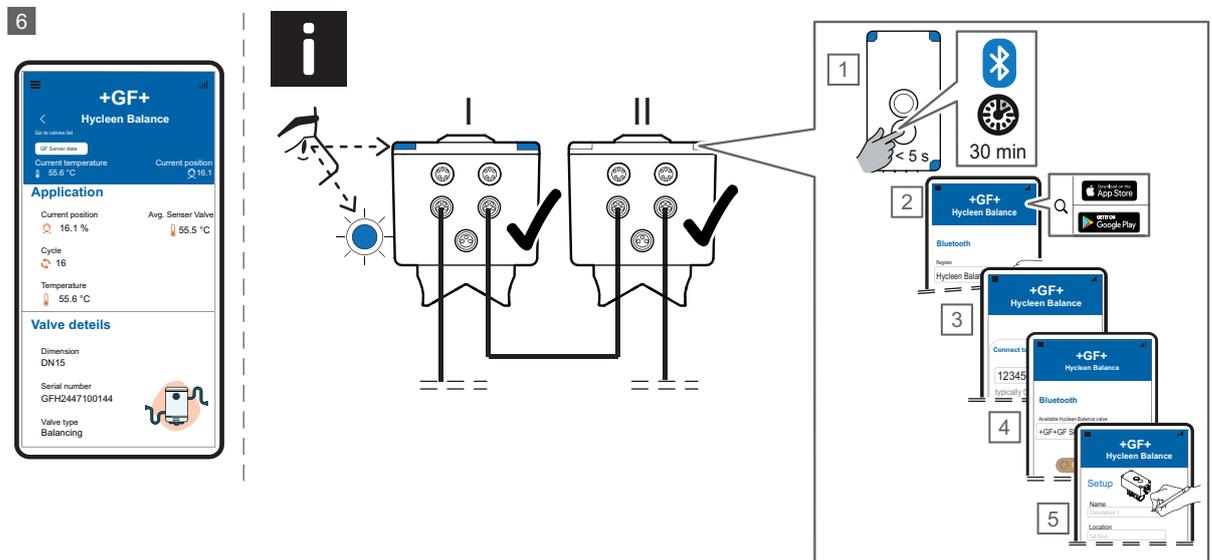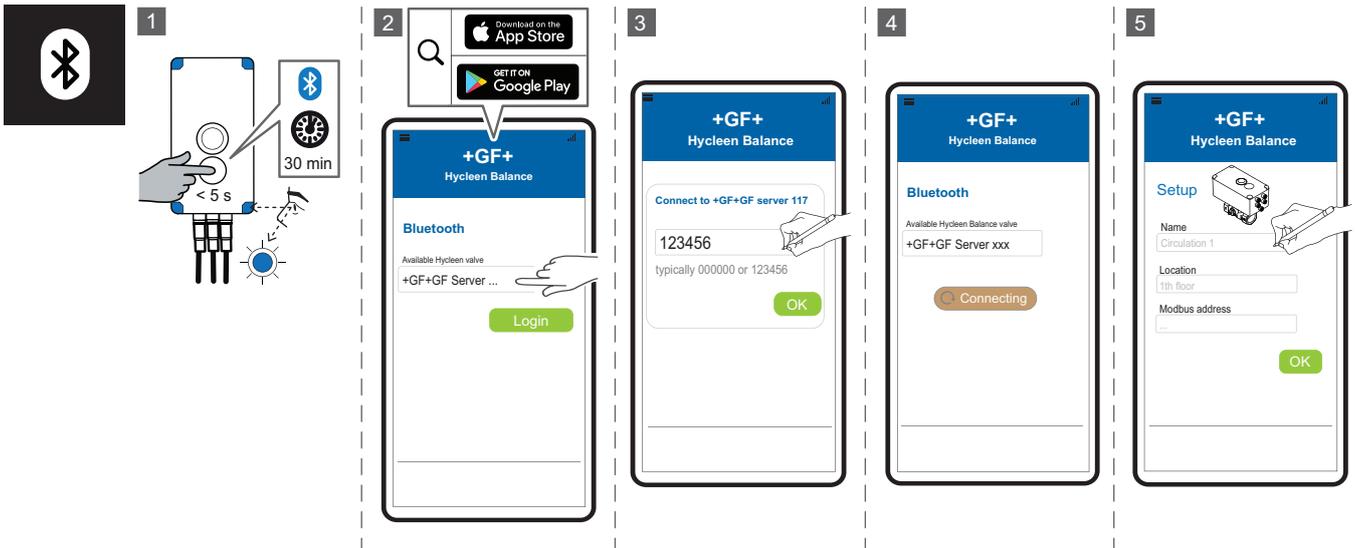



...

	 1x / 30 s	 $\vartheta_{24h \text{ goal}} = +/- 2 \text{ }^\circ\text{C}$
	 2x / 30 s	 $\vartheta_{24h \text{ goal}} = +/- 2 \text{ to } +/- 5 \text{ }^\circ\text{C}$
	 3x / 30 s	 $\vartheta_{24h \text{ goal}} = > 5 \text{ }^\circ\text{C}$
		 Error
		 ON
		 Disinfection
		 Calibration
		 Maintenance

Uponor S.r.l.

Via E. Villorresi, 2/4 20864
Agrate Brianza Monza
Brianza

IM_2603_Hycleen_Balance

GF reserves the right to make changes, without prior notification, to the specification of incorporated components in line with its policy of continuous improvement and development.



www.uponor.com